BID ADDENDUM NO. 2

November 12th, 2026
Corning-Painted Post ASD
2025 Erwin Valley Elem & Admin Building Alterations
2649-160

SED # ERWIN VALLEY 57-10-00-01-0-009-027; ADMIN BUILDING 57-10-00-01-1-001-013

The following Addendum items shall be considered a part of the contract documents prepared by HUNT ENGINEERS, ARCHITECTS, LAND SURVEYORS & LANDSCAPE ARCHITECT, DPC. Bid Document date of October 12, 2026

Clarifications
None

Specifications issued by this Addendum:

None

Drawings issued by this Addendum:

AD2-L1 – REVISED DEMOLITION PLAN - PLAYGROUND
AD2-A1 - KITCHEN DOOR AREA WALL REVISIONS
AD2-A2 - LIBRARY DEMO PLAN UPDATES
AD2-A3 - LIBRARY FLOOR PLAN UPDATES
AD2-TR1 - THEATRICAL RIGGING UPDATES AT STAGE
AD2-P1 - REVISED TOILET ROOM SANITARY PLAN - AREA D
AD2-E1 - REVISE FIRST FLOOR BATHROOM PLANS
AD2-E2 - REVISED KITCHEN PLAN
AD2-E3 - ADDITIONAL ELECTRICAL SITE DETAILS
AD2-E4 - PARTIAL STAGE POWER PLAN
AD2-E5 - PARTIAL FIRST FLOOR DEMOLITION PLAN
AD2-E6 - PARTIAL FIRST FLOOR DEMOLITION PLAN
AD2-E7 - MECHANICAL CONNECTION SCHEDULE
AD2-E8 - ONE LINE REVISIONS
AD2-T1 - REVISED AREA D CORRIDOR
AD2-T2 - GYM TECHNOLOGY PLAN
AD2-T3 - REVISED AREA D CORRIDOR TECHNOLOGY PLAN

Revisions to Project Manual issued by this Addendum:

ITEM AD2-1 Refer to Section 00 01 12- TABLE OF CONTENTS

DELETE Spec section 06 61 00- Cast Polymer Fabrications

ITEM AD2-2 **Refer to Section 01 10 00 - SUMMARY**
ADD paragraph 1.9.A.2.b to read:
"b. Specification Section 03 30 00 - Cast-In-Place Concrete including but not limited to:
1) Provide equipment pads for all trades (all primes to lay out own concrete pads for GC installation).
2) Provide cutting/patching for all trenches within the building (layout of trenches by each Prime Contractor).
3) Interior slabs and all building foundations."

ITEM AD2-3 **Refer to Section 01 10 00 - SUMMARY**
AMEND paragraph 1.9.A to read" The General Trades Contractor shall be responsible for all work shown on Abatement (AB), Architectural (A), Landscape (L), and Food Service Equipment (FS), and Theatrical Rigging (TR) Drawings unless noted otherwise and any site work shown on all other drawings and further defined below:"

ITEM AD2-4 **Refer to Section 01 10 00 - SUMMARY**
AMEND paragraph 1.9.A.12 to read
" 12. Provide the complete work of Division 19 - Theatrical with the following exceptions:
a. Specification Section 19 10 00 - Performance Sound & AV Systems to be provided by Electrical Contractor"

ITEM AD2-5 **Refer to Section 01 10 00 - SUMMARY**
AMEND paragraph 1.12.A to read" The Electrical Contractor shall be responsible for all work shown on Landscape (L), Electrical (E), and Technology (T) and Theatrical Sound (TS) Drawings unless noted otherwise, and any electrical work shown on all other drawings and further defined below:"

ITEM AD2-6 **Refer to Section 01 10 00 - SUMMARY**
ADD paragraph 1.12.A.4.b which reads
"b. Specification Section 10 15 00-Video Display Systems:
1) Provide power and final connections to all electrically lighted Video display systems."

ITEM AD2-7 **Refer to Section 01 10 00 - SUMMARY**
ADD paragraph 1.12.A.11 which reads
" 11. Division 19 - Theatrical:
a. Specification Section 19 10 00 - Performance Sound & AV Systems

ITEM AD2-8 **Refer to Section 06 61 00 – CAST POLYMER FABRICATIONS**
DELETE this specification section in its entirety.

ITEM AD2-9 Refer to Section 07 54 00.16-THERMOPLASTIC MEMBRANE ROOFING - BASE BID

AMEND Paragraph 2.3.A.1.a to read:
"a. Thickness: 60 mil, 0.060 inch , minimum."

ITEM AD2-10 Refer to Section 08 71 00 - DOOR HARDWARE

ADD the following paragraphs to the end of the spec section

"Hardware Group No. 10

3	EA	HINGE	5BB1HW 4.5 X 4.5	652	IVE
1	EA	STOREROOM LOCK	ND80TD RHO	626	SCH
1	EA	FSIC CORE	23-030	626	SCH
1	EA	SURFACE CLOSER	4011 TBSRT	689	LCN
1	EA	KICK PLATE	8400 8" X 2" LDW B-CS	630	IVE
1	EA	WALL STOP	WS406/407CVX	630	IVE
1	EA	MAGNETIC WALL HOLD OPEN	SEM7850	689	LCN
1	SET	SEALS	S88D	DKB	PEM

Hardware Group No. 11

2	EA	DOOR CORD	788-18	↗	689	VON
2	EA	REQUEST TO EXIT CONVERSION KIT HARDWARE	650359	↗		FAL
1	EA	ELEC LATCH RETRACTION CONVERSION KIT	47935967	↗		FAL
2	EA	DOOR CONTACT	7766	↗		SCE
1	EA	POWER SUPPLY	PS902 BBK 900-2RS 120/240 VAC	↗	LGR	SCE
1			CARD READER - WORK OF DIVISION 28			
1	EA	NOTE	PROVIDE POINT TO POINT WIRING DIAGRAMS			
1	EA	NOTE	PROVIDE RISER WIRING DIAGRAMS			

REMOVE CYLINDER DOGGING FROM ACTIVE DOOR AND REPLACE WITH ELECTRIC LATCH RETRACTION. PROVIDE NEW FACE PLATE TO REPLACE CYLINDER DOGGING FACE PLATE."

ITEM AD2-11 Refer to Section 10 15 00 – VIDEO DISPLAY SYSTEMS

ADD 2.1 A "TS-DFAL-PT-CL-G7-10-RGB two- view message center and sign structure."

ITEM AD2-12 Refer to Section 10 15 00 – VIDEO DISPLAY SYSTEMS

AMEND 2.2 C 4. "64 pixel rows high by 240 pixel column wide."

ITEM AD2-13 Refer to Section 12 36 00 – COUNTERTOPS
DELETE paragraph 1.5.B in its entirety.

ITEM AD2-14 Refer to Section 32 31 19 – DECORATIVE METAL FENCES AND GATES
DELETE 2.3 B ’12 feet high by 6 feet long;.”

ITEM AD2-15 Refer to Section 32 31 19 – DECORATIVE METAL FENCES AND GATES
AMEND 2.3 C 1. ”Size: 2 ½”, 16 gauge with manufacturer’s standard cap.

ITEM AD2-16 Refer to Section 32 31 19 – DECORATIVE METAL FENCES AND GATES
DELETE 2.3 D 1. In its entirety.

ITEM AD2-17 Refer to Section 32 31 19 – DECORATIVE METAL FENCES AND GATES
AMEND 2.3 E 3. To read: ‘Style: Majestic’

ITEM AD2-18 Refer to Section 32 31 19 – DECORATIVE METAL FENCES AND GATES
AMEND 2.3 E 2. Size: ‘3/4”, 18 gauge.”

Revisions to Drawings issued by this Addendum:

ITEM AD2-19 Refer to Drawings AD-A3.1 & AD-A3.2
AMEND Exterior Elevation Note #5 to read “PREP AND PAINT EXISTING DECORATIVE DOOR AND FRAME. WINDOW MUNTINS NOT PART OF SCOPE.”

ITEM AD2-20 Refer to Drawing EV-L1.1 SITE DEMOLITION PLAN
ADD Drawing AD2-L1 – REVISED DEMOLITION PLAN - PLAYGROUND, as issued in this addendum.

ITEM AD2-21 Refer to Drawing EV-L8.1 SITE EROSION AND SEDIMENT CONTROL DETAILS
AMEND Detail 6: Title block to read: “CONSTRUCTION ENTRANCE DETAIL. “

ITEM AD2-22 Refer to Drawings EV-A0.1, EV-A0.2, EV-A0.3 & EV-A0.4
AMEND Demo Note #D4 to read “REMOVE EXISTING SHELVING /CASEWORK WITH CARE AND STORE FOR REINSTALLATION.”

ITEM AD2-23 Refer to Drawings EV-A0.1, EV-A0.2, EV-A0.3 & EV-A0.4
AMEND Demo Note #D13 to read “REMOVE EXTERIOR WALL SYSTEM UNDER CLERESTORY WINDOW TO EXTENTS SHOWN ON DEMO WALL SECTION (3/EV-**A0.2**).”.

ITEM AD2-24 Refer to Drawings EV-A0.1, EV-A0.2, EV-A0.3 & EV-A0.4
AMEND Demo Note #D5 to read "REMOVE EXISTING CARPET FLOORING AND BASE IN ITS ENTIRETY. EXISTING WIREMOLDING FOR DATA CABLES IN CONFLICT WITH NEW BASE INSTALLATION SHOULD BE TEMPORARILY REMOVED AND CABLES CLEARED OUT OF THE FLOOR BASE AREA FOR NEW FLOOR BASE INSTALLATION. PREPARE EXISTING CONCRETE SLAB FOR NEW FLOORING.".

ITEM AD2-25 Refer to Drawings EV-A0.1, EV-A0.2, EV-A0.3 & EV-A0.4
AMEND Demo Note #D19 to read "REMOVE FIRE EXTINGUISHER **& SIGNAGE** WITH CARE AND STORE FOR REINSTALLATION.".

ITEM AD2-26 Refer to Drawings EV-A0.1, EV-A0.2, EV-A0.3 & EV-A0.4
AMEND Demo Note #D21 to read "DOOR, HARDWARE AND FRAME ASSEMBLY TO BE REMOVED WITH CARE, INCLUDING MAGNETIC HOLD OPEN. COORDINATE WITH EC. PROTECT AND STORE IN A SAFE PLACE FOR REINSTALLATION IN A DIFFERENT LOCATION.".

ITEM AD2-27 Refer to Drawings EV-A0.5 ROOF DEMOLITION PLAN
AMEND General Roof Note #B to read "BY ALTERNATE **#4**. ALL MECHANICAL EQUIPMENT IS TO BE REMOVED BY THE HVAC CONTRACTOR. ALL ROOFTOP MECHANICAL EQUIPMENT SHALL BE TESTED PRIOR TO REMOVAL IN THE PRESENCE OF THE OWNERS REPRESENTATIVE. FOLLOWING REINSTALLATION, EQUIPMENT WILL AGAIN BE TESTED IN THE PRESENCE OF THE OWNERS REPRESENTATIVE.".

ITEM AD2-28 Refer to Drawing EV-A0.1 FIRST FLOOR DEMOLITION PLAN - AREA A
AMEND View #1 as clouded on Sheet AD2-A2 issued with this addendum.

ITEM AD2-29 Refer to Drawing EV-A0.2 FIRST FLOOR DEMOLITION PLAN - AREA B
ADD Demo Note D19 pointing to the kitchen wall shown demoed.

ITEM AD2-30 Refer to Drawing EV-A1.1 FIRST FLOOR PLAN - AREA A
AMEND View #1 as clouded on Sheet AD2-A3 issued with this addendum.

ITEM AD2-31 Refer to Drawing EV-A1.2 FIRST FLOOR PLAN - AREA B
AMEND View #2 as clouded on Sheet AD2-A1 issued with this addendum.

ITEM AD2-32 Refer to Drawings EV-A1.1, EV-A1.2, EV-A1.3 & EV-A1.4
ADD Plan Note #23 to read "INSTALL STORED SHELVING & CASEWORK BACK TO ORIGINAL LOCATION ONCE NEW CARPET AND BASE ARE INSTALLED.".

ITEM AD2-33 Refer to Drawings EV-A1.1, EV-A1.2, EV-A1.3 & EV-A1.4

AMEND Plan Note #15 to read "REINSTALL STORED FIRE EXTINGUISHER **& SIGNAGE.**".

ITEM AD2-34 Refer to Drawing EV-A1.4 FIRST FLOOR PLAN - AREA D
ADD Door tag "C400-1" to the existing exterior double door between Room DATA ST-1 & Room J.C. ST-2 in View #1.

ITEM AD2-35 Refer to Drawing EV-A4.1 WALL SECTIONS
AMEND View#1 by adding a note pointing to the window sill. Note is to read "WINDOW SILL AS SCHEDULED PER FINISH DRAWINGS".

ITEM AD2-36 Refer to Drawing EV-A5.1 ENLARGED T.R. PLANS + DETAILS
AMEND "SIZE" for SYMBOL "1A" to read "**36""**" under "TOILET ROOM ACCESSORY SCHEDULE".

ITEM AD2-37 Refer to Drawing EV-A6.1 DOOR & GLAZING SCHEDULE AND DETAILS
AMEND Door "SIZE" for Door 103-1 to be 3'-6"x7'-0" under "DOOR SCHEDULE".

ITEM AD2-38 Refer to Drawing EV-A6.1 DOOR & GLAZING SCHEDULE AND DETAILS
AMEND "HARDWARE SET" for Door 103-1 to read "10" under "DOOR SCHEDULE".

ITEM AD2-39 Refer to Drawing EV-A6.1 DOOR & GLAZING SCHEDULE AND DETAILS
DELETE Hardware set numbers for Doors CY-1 & CY-2 under "DOOR SCHEDULE".

ITEM AD2-40 Refer to Drawing EV-A6.1 DOOR & GLAZING SCHEDULE AND DETAILS
ADD Door C400-1 to "DOOR SCHEDULE". C400-1 is existing exterior aluminum wide stile double door. Existing door size is PR@3'-4"x7'-10". "HARDWARE SET" for door C400-1 is "11". "NOTES" for door C400-1 is to read "RETROFIT EXISTING DOUBLE DOOR WITH FIELD RETROFIT KITS TO ACCEPT CARD READER"

ITEM AD2-41 Refer to Drawing EV-A8.1 – FIRST FLOOR AND WALL FINISH PLAN – AREA A
AMEND Note at library 206 exterior doors to read: "CPT-1,2,3,4,5,6,7,8,9."

ITEM AD2-42 Refer to Drawing EV-A8.1 - FIRST FLOOR AND WALL FINISH PLAN – AREA A
ADD F8 to construction notes interior floor finish to read: "EXISTING TRANSITION TO BE REINSTALLED."

ITEM AD2-43 Refer to Drawing EV-A8.1 - FIRST FLOOR AND WALL FINISH PLAN – AREA A
ADD F8 to First Floor and Wall Finish Plan – Area A and Enlarged Library Floor Pattern Plan at Library 206 exterior doors.

ITEM AD2-44 Refer to Drawing EV-A8.1 - FIRST FLOOR AND WALL FINISH PLAN – AREA A
REMOVE Note TS-2 from exterior doors in Enlarged Library Floor Pattern Plan.

ITEM AD2-45 Refer to Drawing EV-A8.1 - FIRST FLOOR AND WALL FINISH PLAN – AREA A
AMEND Note at electrical room 206C to read: "TS-2."

ITEM AD2-46 Refer to Drawing EV-A8.1 - FIRST FLOOR AND WALL FINISH PLAN – AREA A
ADD Note W15 to Kiln 201B.

ITEM AD2-47 Refer to Drawings EV-A8.1, EV-A8.2 & EV-A8.3
ADD Note W12 to "CONSTRUCTION NOTES – INTERIOR WALL FINISH" to read: "PATCH TO MATCH CLASSROOM WALL PAINT WHERE WORK IN TOILET ROOMS IMPACT EXISTING WALL FINISHES."

ITEM AD2-48 Refer to Drawings EV-A8.1, EV-A8.2 & EV-A8.3
ADD Note W15 to "CONSTRUCTION NOTES – INTERIOR WALL FINISH" to read: "PATCH TO MATCH EXISTING WALL AND CEILING FINISHES WHERE FINISHES ARE IMPACTED."

ITEM AD2-49 Refer to Drawings EV-A8.1, EV-A8.2 & EV-A8.3
ADD Note W13 to "CONSTRUCTION NOTES – INTERIOR WALL FINISH" to read: "PATCH TO MATCH EXISTING WALL TILE WHERE WALL IS BEING REPLACED."

ITEM AD2-50 Refer to Drawing EV-A8.2 – FIRST FLOOR AND WALL FINISH PLAN – AREA B
ADD Note W13 to new wall in Kitchen 103 and Receiving V101.

ITEM AD2-51 Refer to Drawing EV-A8.2 – FIRST FLOOR AND WALL FINISH PLAN – AREA D
ADD Note W12 to classrooms where toilet room walls are being replaced and need new finishes.

ITEM AD2-52 Refer to Drawing EV-A8.2 - FIRST FLOOR AND WALL FINISH PLAN – AREA B
REMOVE Both notes, "W11", from North-West walls where chair lift is being installed.

ITEM AD2-53 Refer to Drawing EV-A9.1 – INTERIOR ROOM FINISH SCHEDULES
AMEND Cafeteria 101 remarks to read: "REFINISH EXISTING WOOD PANELING USING STN-2. SAND AND REFINISH STAIRS WITH STN-1, PTM EXISTING."

ITEM AD2-54 Refer to Drawing EV-A9.1 – INTERIOR FINISH SCHEDULES
AMEND Ceiling Finish column to read: "ACT-1".

ITEM AD2-55 Refer to Drawing EV-TR1.1 - THEATRICAL RIGGING PLAN, SECTION & ELEVATION - AREA B
AMEND View #1 as clouded on Sheet AD2-TR1 issued with this addendum.

ITEM AD2-56 Refer to Drawing EV-H3.1 – SCHEDULES & DETAILS
ADD Schedule note 5 to FCU-1 and FCU-2 to REMARKS & NOTES on FAN COIL UNIT SCHEDULE.

ITEM AD2-57 Refer to Drawing EV-P0.1 - FIRST FLOOR DEMOLITION PLANS - AREA D
AMEND Note D1 to read: "DISCONNECT AND REMOVE WATER CLOSET AND ALL ASSOCIATED ACCESSORIES IN ITS ENTIRETY. DISCONNECT AND REMOVE COLD WATER PIPING AND ALL ASSOCIATED ACCESSORIES BACK TO MAIN AND PREPARE FOR RECONNECTION IN NEW WORK. DISCONNECT AND REMOVE SANITARY PIPING AND ALL ASSOCIATED ACCESSORIES WITHIN THE CHASE ABOVE FLOOR AND PREPARE FOR RECONNECTION IN SAME LOCATION IN NEW WORK. DISCONNECT AND REMOVE VENT PIPING AND ALL ASSOCIATED ACCESSORIES BACK TO CEILING AND CAP."

ITEM AD2-58 Refer to Drawing EV-P1.1 - FIRST FLOOR PLANS - AREA D
AMEND Detail 1 with AD2-P1 - REVISED TOILET ROOM SANITARY PLAN - AREA D, as issued in this addendum.

ITEM AD2-59 Refer to Drawing EV-E0.2 - FIRST FLOOR DEMOLITION PLAN - AREA B
AMEND Detail 1 with AD2-E5 - PARTIAL FIRST FLOOR DEMOLITION PLAN, as issued in this addendum.

ITEM AD2-60 Refer to Drawing EV-E0.2 - FIRST FLOOR DEMOLITION PLAN - AREA B
AMEND Detail 1 with AD2-E6 - PARTIAL FIRST FLOOR DEMOLITION PLAN, as issued in this addendum.

ITEM AD2-61 Refer to Drawing EV-E1.2 - FIRST FLOOR POWER PLAN - AREA B
AMEND Detail 1 with AD2-E4 - PARTIAL STAGE POWER PLAN, as issued in this addendum.

ITEM AD2-62 Refer to Drawing EV-E1.3 - FIRST FLOOR POWER PLAN - AREA D
AMEND "Construction Notes – Power" note "P4" to read as follows: "Provide 120V power to serve flush valve and sink from receptacle circuit service classroom. Coordinate with other trades"

ITEM AD2-63 Refer to Drawing EV-E2.1 - FIRST FLOOR LIGHTING & FA PLAN - AREA B
AMEND Detail 1 with AD2-E2 - REVISED KITCHEN PLAN, as issued in this addendum.

ITEM AD2-64 Refer to Drawing EV-E2.2 - FIRST FLOOR LIGHTING & FA PLAN - AREA D
AMEND Detail 1 with AD2-E1 - REVISE FIRST FLOOR BATHROOM PLANS, as issued in this addendum.

ITEM AD2-65 Refer to Drawing EV-E4.1 - SITE ELECTRICAL UTILITY PLAN

ADD Detail 1 on AD2-E3 - ADDITIONAL ELECTRICAL SITE DETAILS, as issued in this addendum to EV-E4.1 - SITE ELECTRICAL UTILITY PLAN.


ITEM AD2-66 Refer to Drawing EV-E5.1 - SCHEDULES & DETAILS

AMEND "Mechanical Equipment Connection and Control Schedule" with AD2-E7 - MECHANICAL CONNECTION SCHEDULE, as issued in this addendum.

ITEM AD2-67 Refer to Drawing EV-E5.1 - SCHEDULES & DETAILS

AMEND "One Line Diagram" with AD2-E8 - ONE LINE REVISIONS, as issued in this addendum.

End of Addendum 2

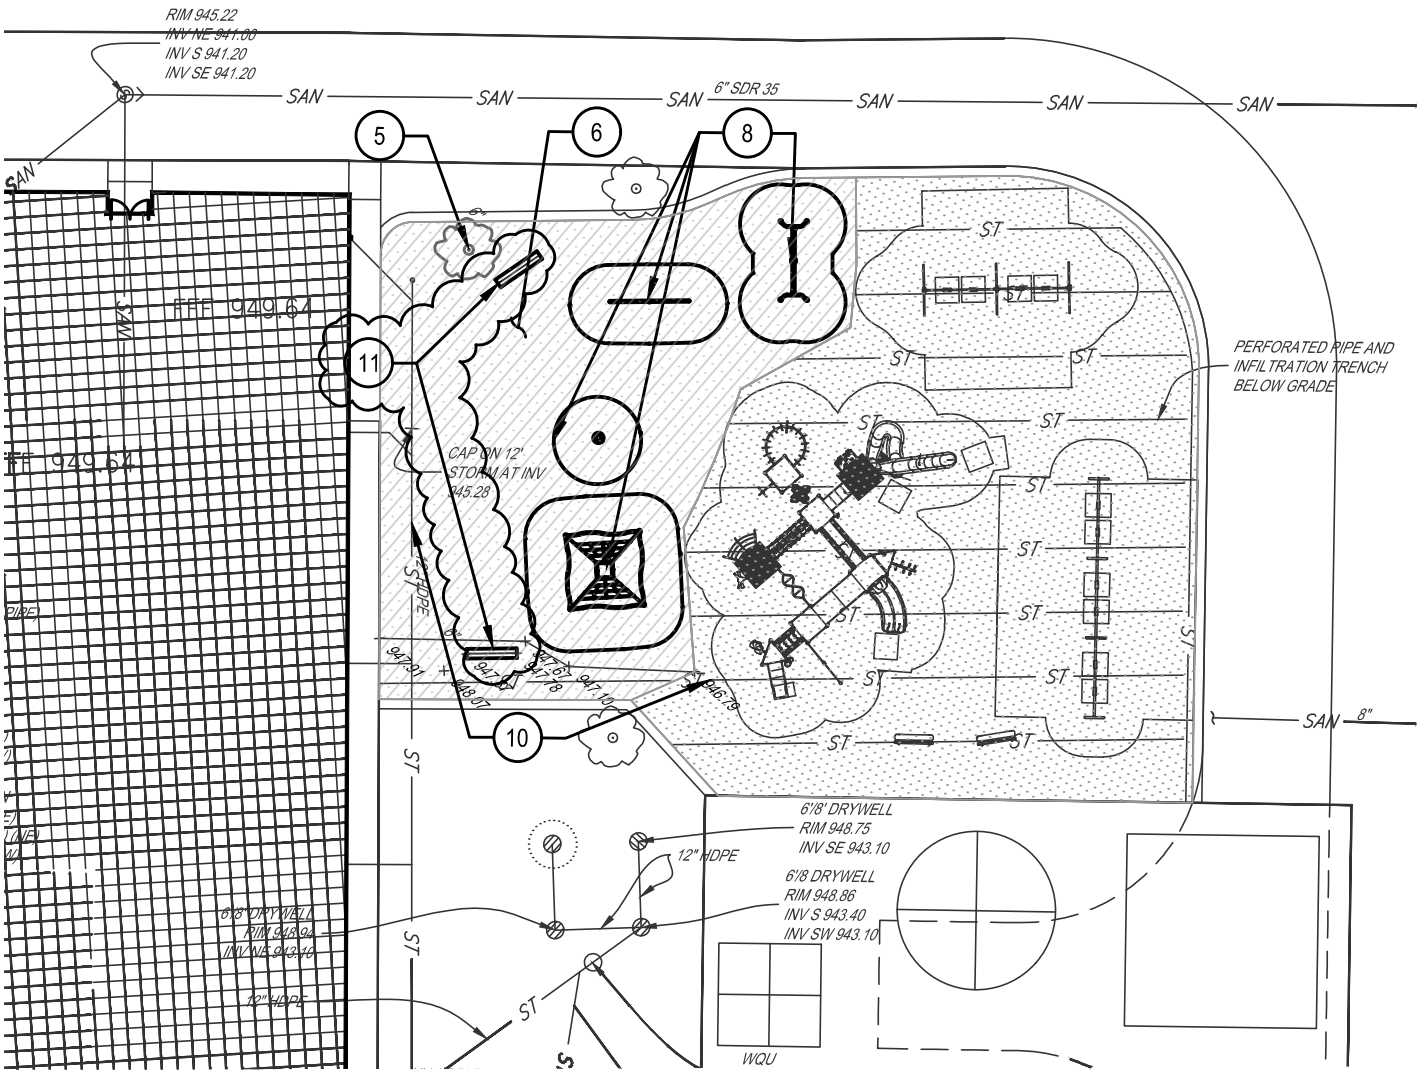

8. ALTERNATE 2: REMOVE EXISTING PLAYGROUND EQUIPMENT AND FOUNDATIONS.
9. IF NECESSARY FOR NEW UTILITIES, TEMPORARY REMOVE FENCE AND GATE AND REINSTALL IN THE SAME LOCATION AFTER PROJECT COMPLETION.
10. PROTECT EXISTING UTILITY LINE AND STRUCTURES TO REMAIN.
11. REMOVE EXISTING BENCHES AND FOUNDATIONS.

REVISED DEMOLITION PLAN - PLAYGROUND

2025 ERWIN VALLEY ELEM&ADMIN BUILDING ALT

CORNING-PAINTED POST AREA SCHOOL DISTRICT

16 BEARTOWN ROAD, PAINTED POST, NY 14870


Copyright: 2026

HUNT ENGINEERS | ARCHITECTS | SURVEYORS
HORSEHEADS, NY 607 - 358 - 1000 ROCHESTER, NY 585 - 327 - 7950
TOWANDA, PA 570 - 265 - 4868 BINGHAMTON, NY 607 - 798 - 8081
ALBANY, NY 607 - 798 - 8081 WWW.HUNT-EAS.COM
NY CERTIFICATE NO. 0018220 PA CERTIFICATE NO. TSC2203131464-1

AD2-L1

DATE:

PROJECT NO: 2649-160

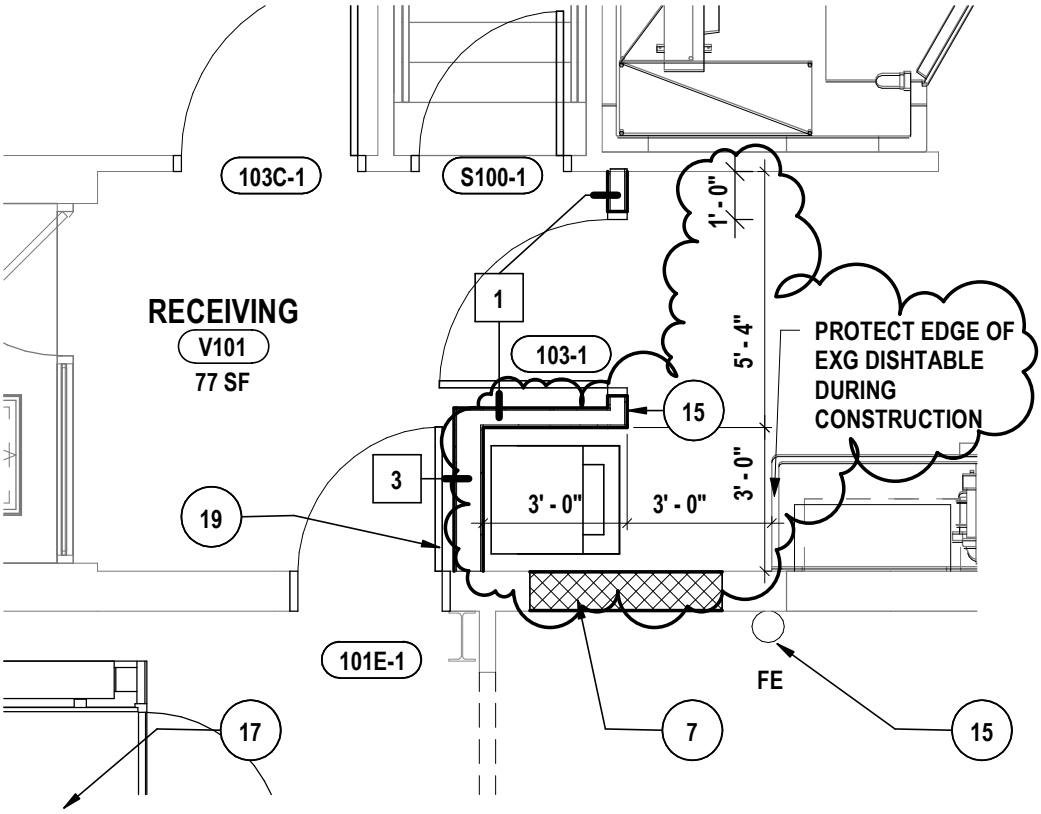

1 AD - FIRST FLOOR PLAN - AREA B KITCHEN - REF. 2/EV-A1.2

1/4" = 1'-0"

KITCHEN DOOR AREA WALL REVISIONS

2025 ERWIN VALLEY ELEM ALTERATIONS

CORNING-PAINTED POST ASD

16 BEARTOWN ROAD, PAINTED POST, NY 14870


Copyright: 2026

HUNT ENGINEERS | ARCHITECTS | SURVEYORS
ALBANY, NY - BINGHAMTON, NY - HORSEHEADS, NY - ROCHESTER, NY
TOWANDA, PA - WILLIAMSPORT, PA
WWW.HUNT-EAS.COM 607 - 358 - 1000
NY CERTIFICATE NO. 0018220 PA CERTIFICATE NO. TSC2203131464-1

AD2-A1

DATE: 11/12/26

PROJECT NO: 2649-160

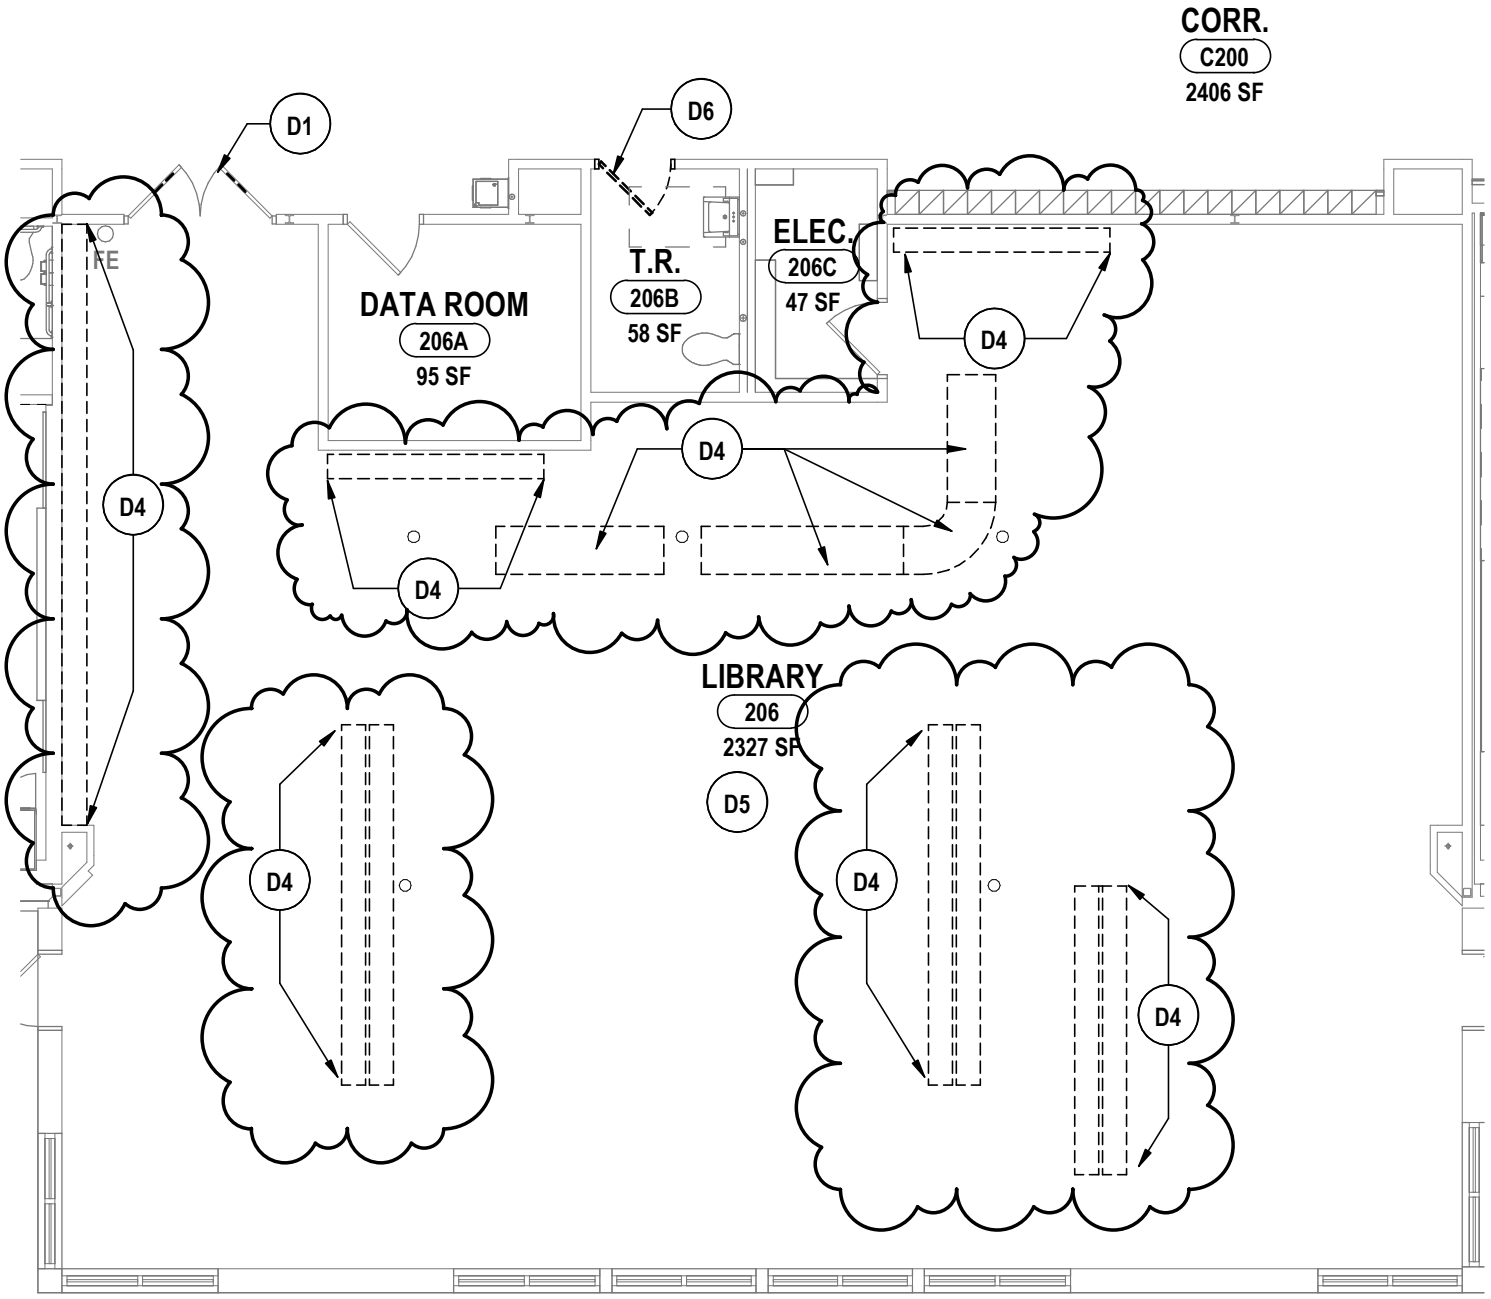

1 AD - FIRST FLOOR DEMOLITION PLAN - AREA A LIBRARY - REF. 1/EV-A0.1

1/8" = 1'-0"

LIBRARY DEMO PLAN UPDATES

2025 ERWIN VALLEY ELEM ALTERATIONS

CORNING-PAINTED POST ASD

16 BEARTOWN ROAD, PAINTED POST, NY 14870

Copyright: 2026


HUNT ENGINEERS | ARCHITECTS | SURVEYORS

ALBANY, NY - BINGHAMTON, NY - HORSEHEADS, NY - ROCHESTER, NY
TOWANDA, PA - WILLIAMSPORT, PA
WWW.HUNT-EAS.COM 607 - 358 - 1000
NY CERTIFICATE NO. 0018220 PA CERTIFICATE NO. TSC2203131464-1

AD2-A2

DATE: 11/12/26

PROJECT NO: 2649-160

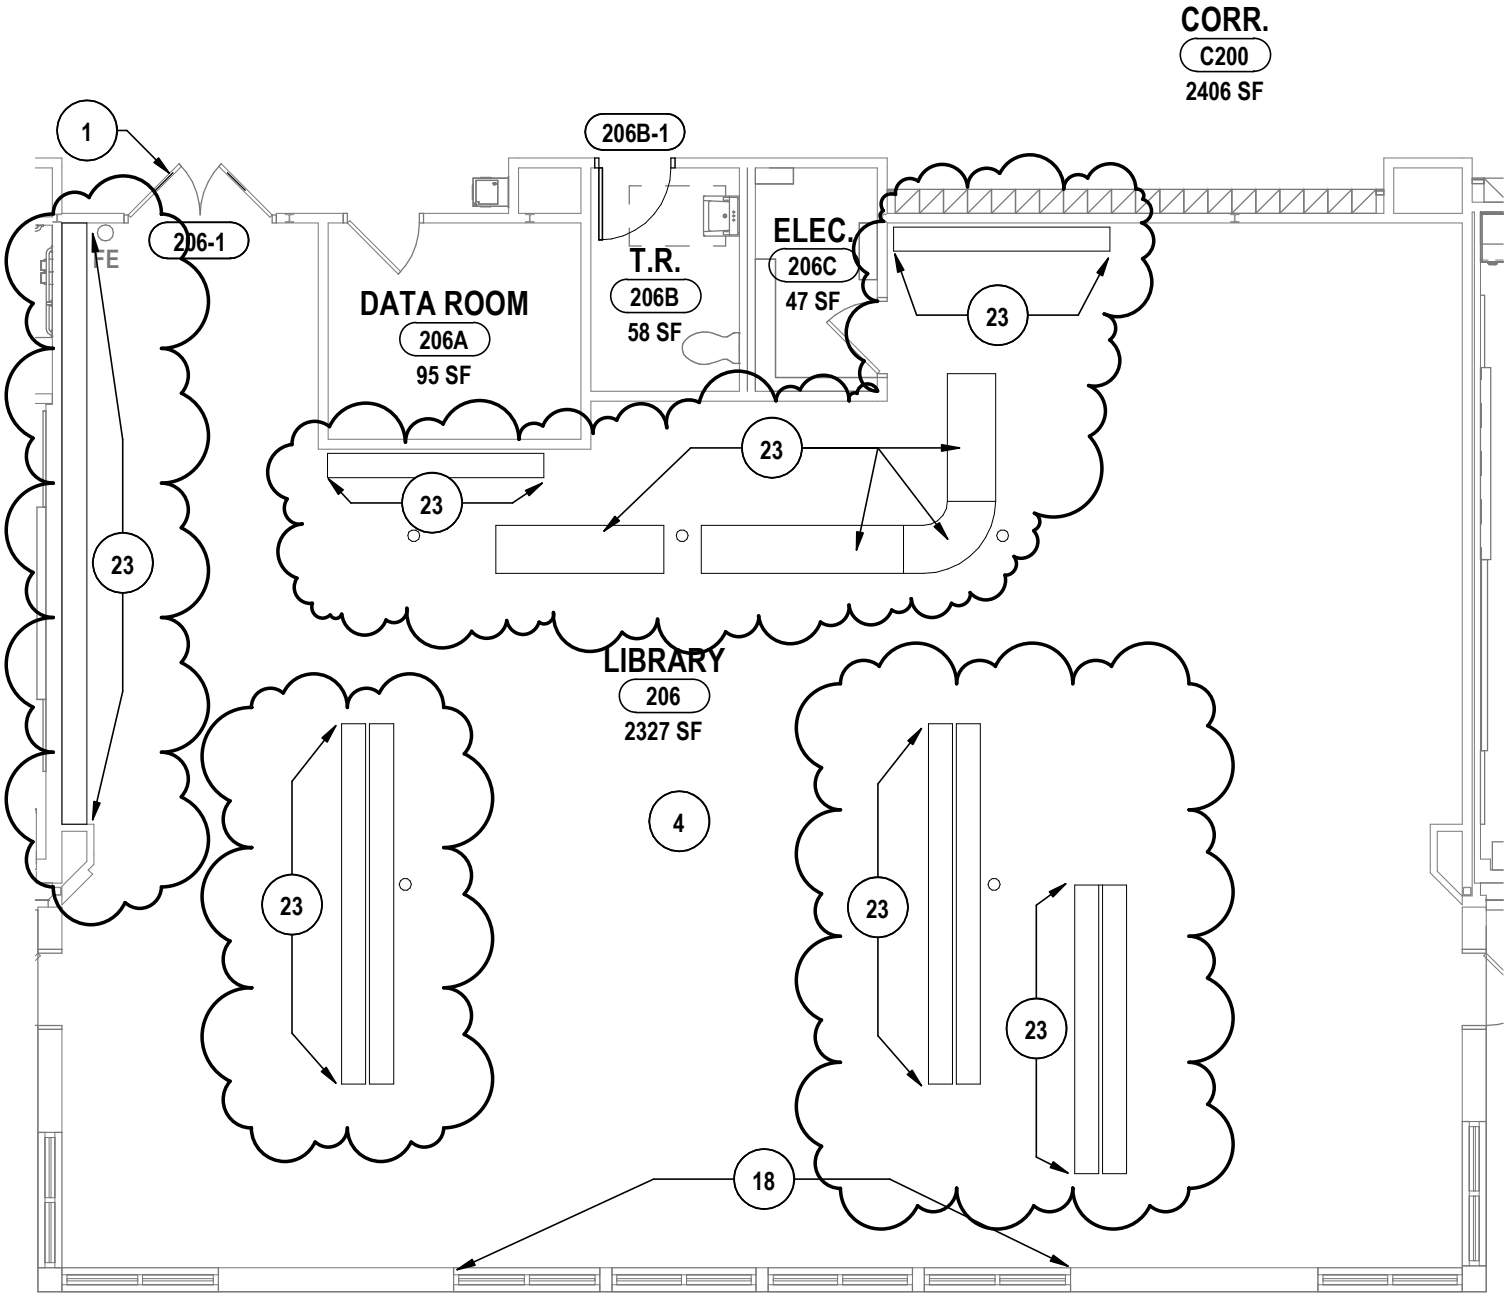

1 AD - FIRST FLOOR PLAN - AREA A - REF. 1/EV-A1.1

1/8" = 1'-0"

LIBRARY FLOOR PLAN UPDATES

2025 ERWIN VALLEY ELEM ALTERATIONS

CORNING-PAINTED POST ASD

16 BEARTOWN ROAD, PAINTED POST, NY 14870

Copyright: 2026


HUNT ENGINEERS | ARCHITECTS | SURVEYORS

ALBANY, NY - BINGHAMTON, NY - HORSEHEADS, NY - ROCHESTER, NY
TOWANDA, PA - WILLIAMSPORT, PA
WWW.HUNT-EAS.COM 607 - 358 - 1000
NY CERTIFICATE NO. 0018220 PA CERTIFICATE NO. TSC2203131464-1

AD2-A3

DATE: 11/12/26

PROJECT NO: 2649-160

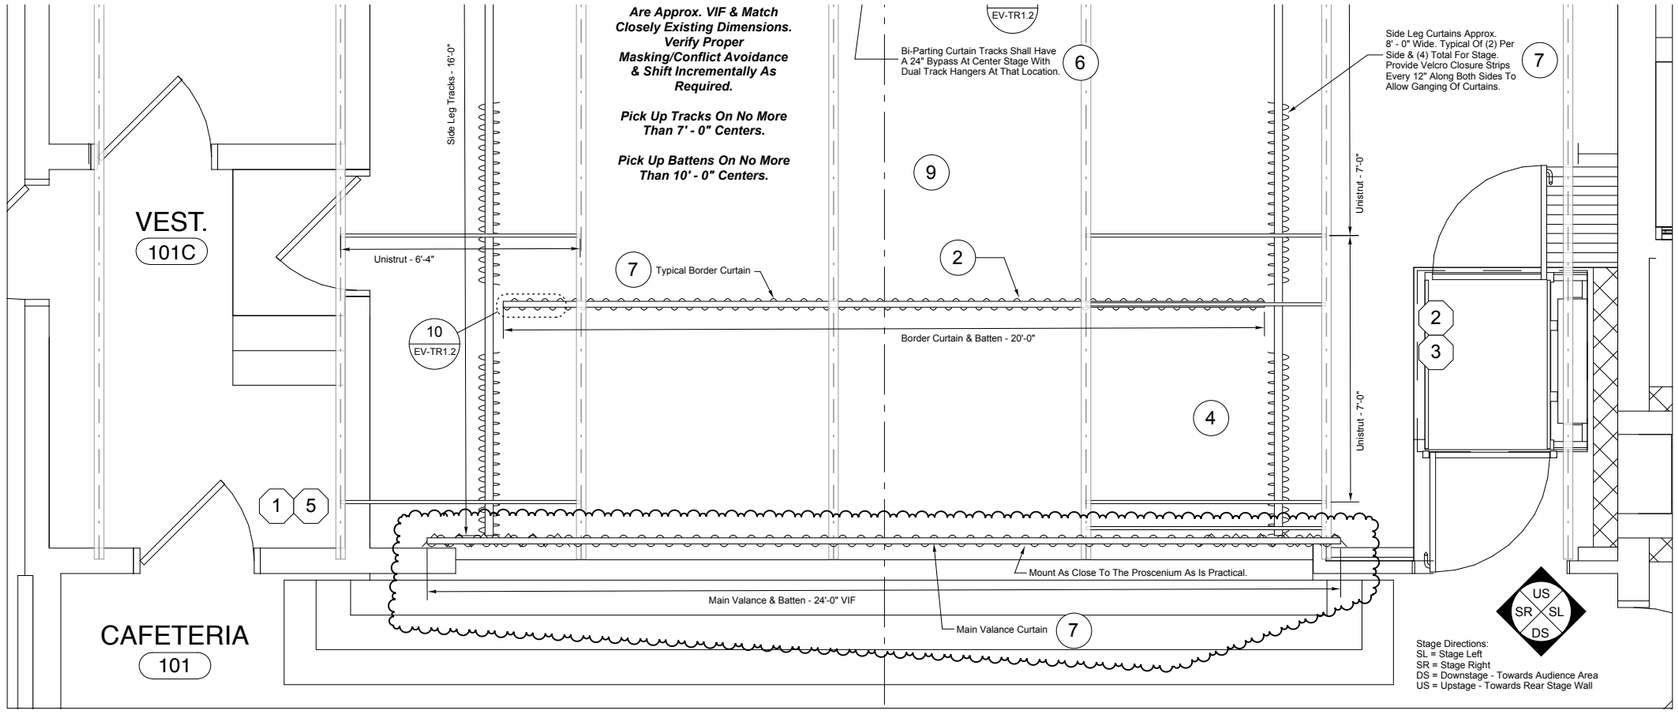

1 UNISTRUT, CURTAIN & TRACK PLAN

1/4" = 1'-0"

DRAWN BY:	SPJ
CHECKED BY:	SPJ
DATE:	11/12/26

Copyright 2026


"IT IS A VIOLATION OF THE LAW FOR ANY PERSON TO MAKE UNAUTHORIZED ALTERATIONS OR ADDITIONS TO PLANS BEARING A LICENSED ENGINEER'S, ARCHITECT'S OR SURVEYOR'S SEAL."

HUNT ENGINEERS | ARCHITECTS | SURVEYORS
ALBANY, NY - BINGHAMTON, NY - HORSEHEADS, NY - ROCHESTER, NY
TOWANDA, PA - WILLIAMSPORT, PA
WWW.HUNT-EAS.COM 607 - 358 - 1000
NY CERTIFICATE NO. 0018220 PA CERTIFICATE NO. TSC220313464-1

THEATRICAL RIGGING UPDATES AT STAGE
2025 ERWIN VALLEY ELEM ALTERATIONS
CORNING-PAINTED POST ASD
16 BEARTOWN ROAD, PAINTED POST, NY 14870

AD2-TR1

PROJECT NO: 2649-160

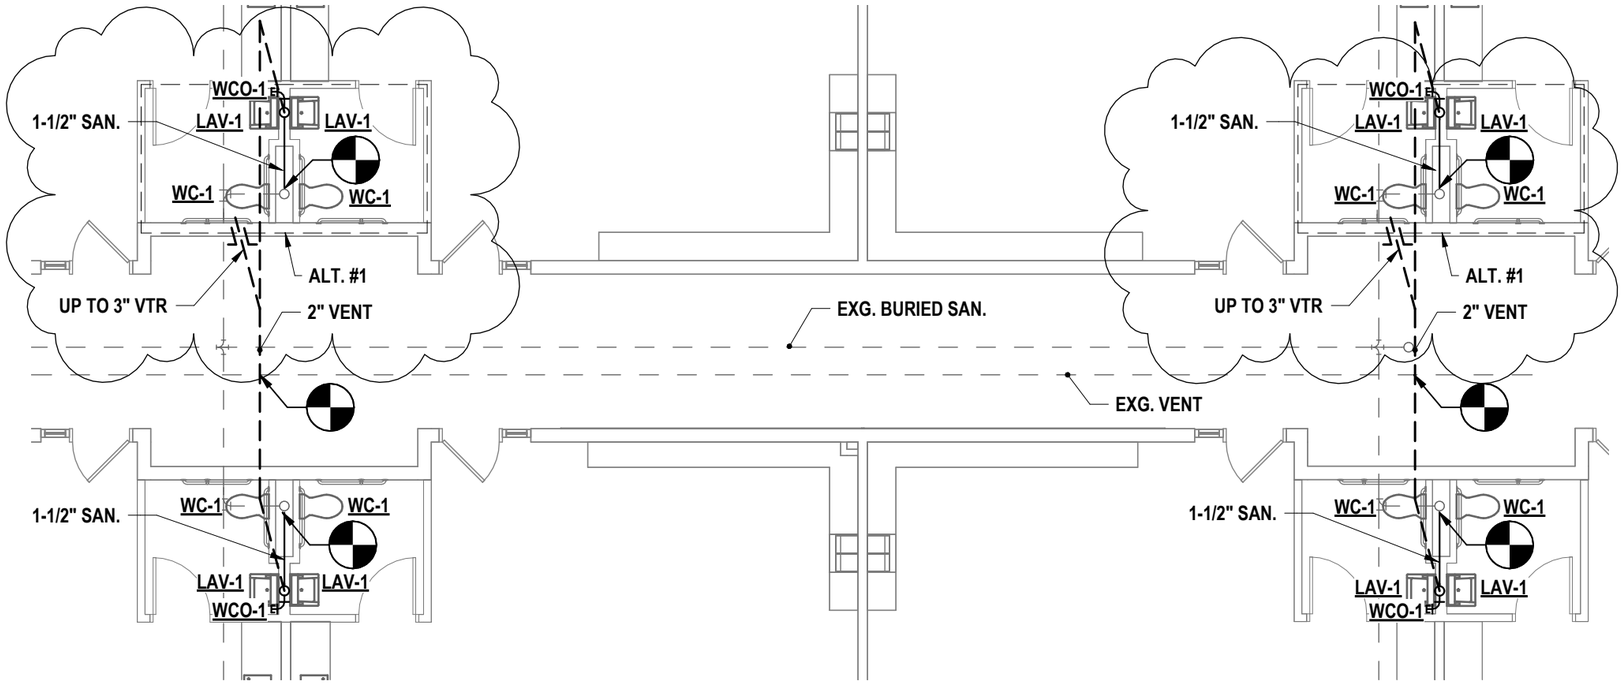

1 REVISED TOILET ROOM SANITARY PLAN - AREA D

1/8" = 1'-0"

DRAWN BY:	CJH
CHECKED BY:	JDG
DATE:	03/17/2026
SCALE:	1/8" = 1'-0"
REVISION:	

Copyright 2022

"IT IS A VIOLATION OF THE LAW FOR ANY PERSON TO MAKE UNAUTHORIZED ALTERATIONS OR ADDITIONS TO PLANS BEARING A LICENSED ENGINEER'S, ARCHITECT'S OR SURVEYOR'S SEAL."

HUNT ENGINEERS | ARCHITECTS | SURVEYORS
HORSEHEADS, NY 607 - 358 - 1000 ROCHESTER, NY 585 - 327 - 7950
TOWANDA, PA 570 - 265 - 4868

REVISED TOILET ROOM SANITARY PLAN - AREA D

2025 ERWIN VALLEY ELEM & ADMIN BUILDING
ADDITION/RENOVATIONS


PAINTED POST AREA SCHOOL DISTRICT

16 BEARTOWN ROAD, PAINTED POST, NY 14870

SED NUMBERS EV: 57-10-00-01-0-009-027, AD: 57-10-00-01-1-001-013

AD2-P1

PROJECT NO: 2649-160

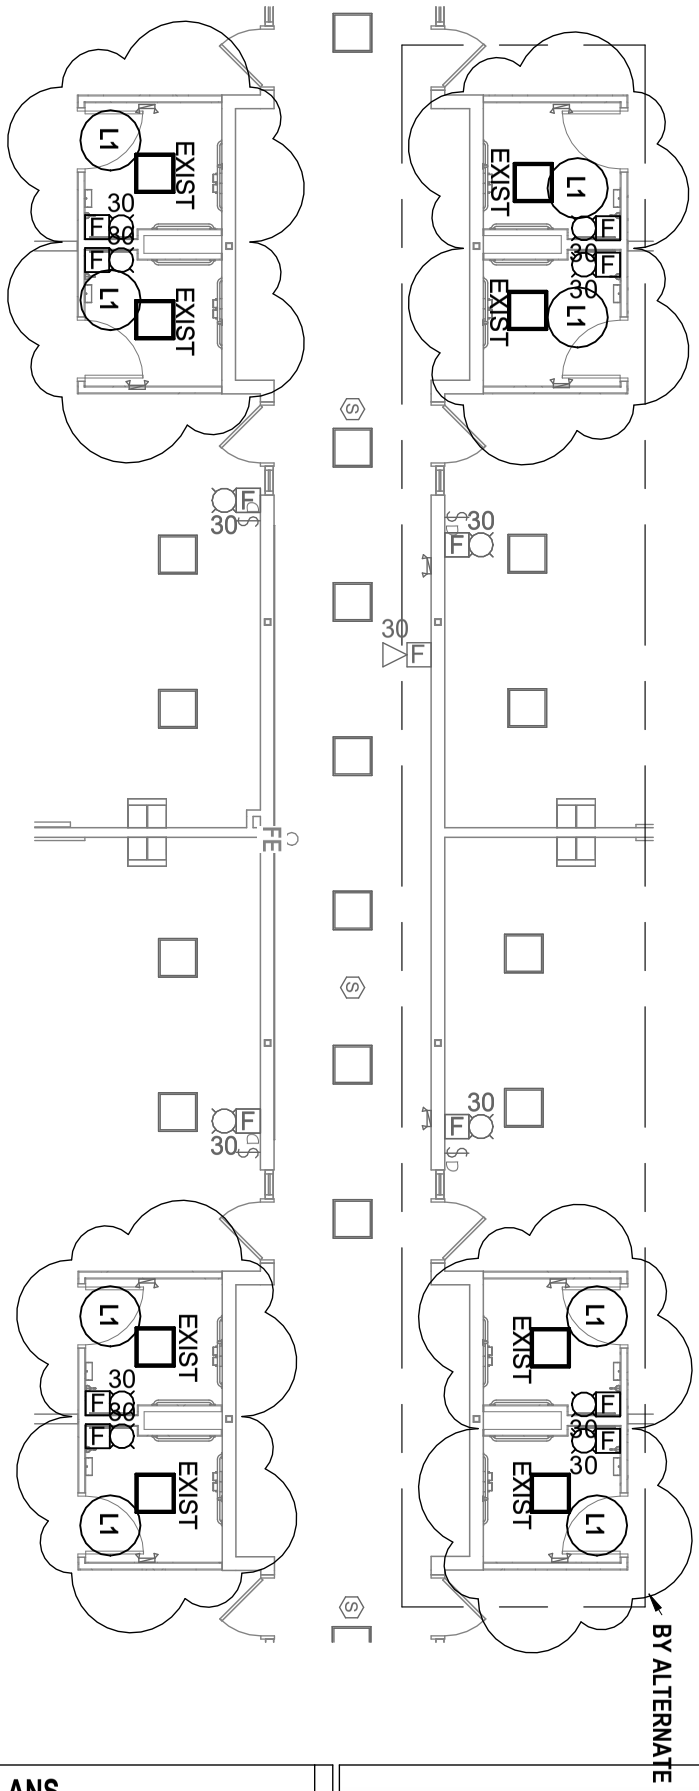

1 FIRST FLOOR LIGHTING & FA PLAN - BATHROOM PLAN

1" = 10'-0"

REVISE FIRST FLOOR BATHROOM PLANS

2025 ERWIN VALLEY ELEM & ADMIN BUILDING ALTERATIONS

CORNING-PAINTED POST AREA SCHOOL DISTRICT

16 BEARTOWN ROAD, PAINTED POST, NY 14870

Copyright: 2026


HUNT ENGINEERS | ARCHITECTS | SURVEYORS

ALBANY, NY - BINGHAMTON, NY - HORSEHEADS, NY - ROCHESTER, NY
TOWANDA, PA - WILLIAMSPORT, PA
WWW.HUNT-EAS.COM 607 - 358 - 1000
NY CERTIFICATE NO. 0018220 PA CERTIFICATE NO. TSC2203131464-1

AD2-E1

DATE: 11/11/26

PROJECT NO: 2649-160

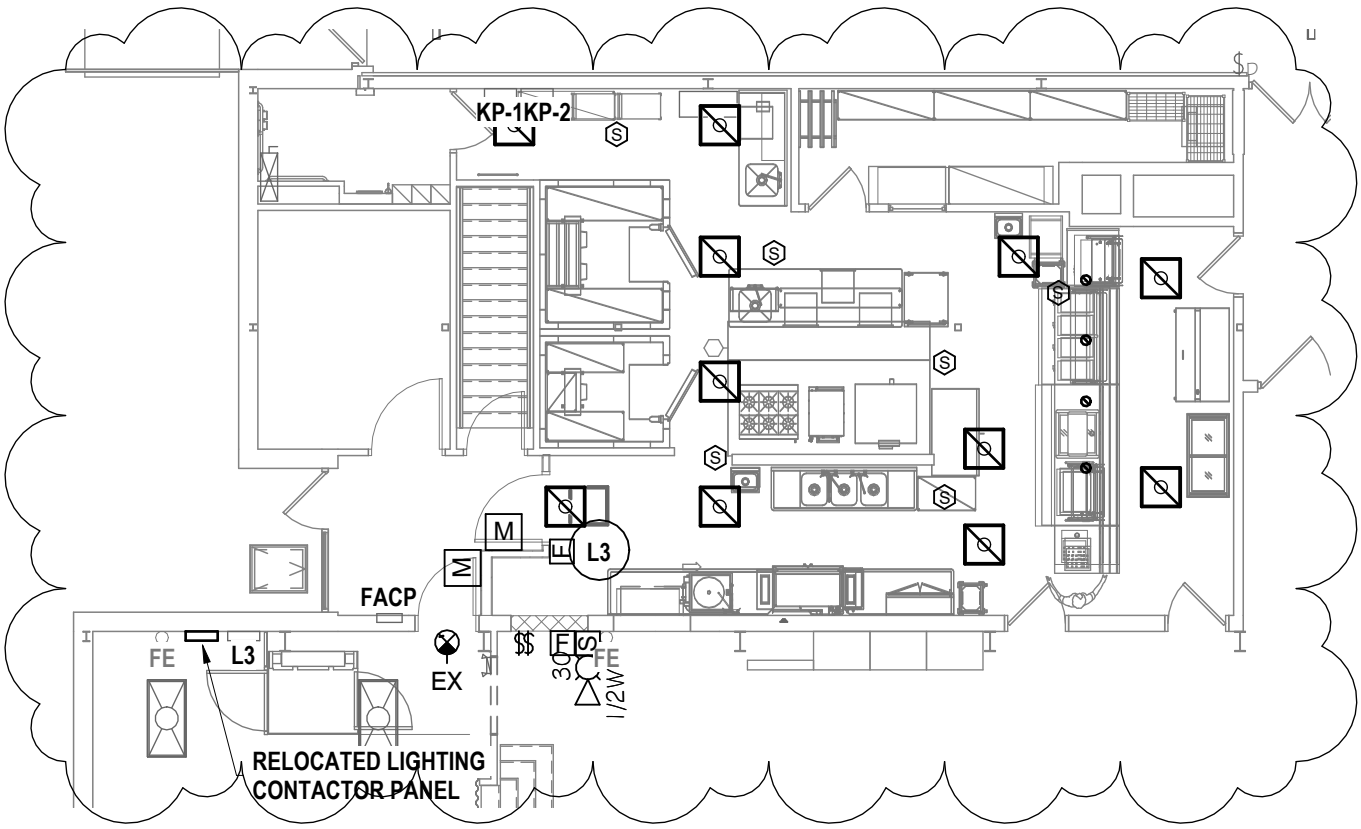

1 FIRST FLOOR LIGHTING & FA PLAN - KITCHEN PLAN

1" = 10'-0"

REVISED KITCHEN PLAN

2025 ERWIN VALLEY ELEM & ADMIN BUILDING ALTERATIONS

CORNING-PAINTED POST AREA SCHOOL DISTRICT

16 BEARTOWN ROAD, PAINTED POST, NY 14870


Copyright: 2026

HUNT ENGINEERS | ARCHITECTS | SURVEYORS
ALBANY, NY - BINGHAMTON, NY - HORSEHEADS, NY - ROCHESTER, NY
TOWANDA, PA - WILLIAMSPORT, PA
WWW.HUNT-EAS.COM 607 - 358 - 1000
NY CERTIFICATE NO. 0018220 PA CERTIFICATE NO. TSC2203131464-1

AD2-E2

DATE: 11/11/26

PROJECT NO: 2649-160

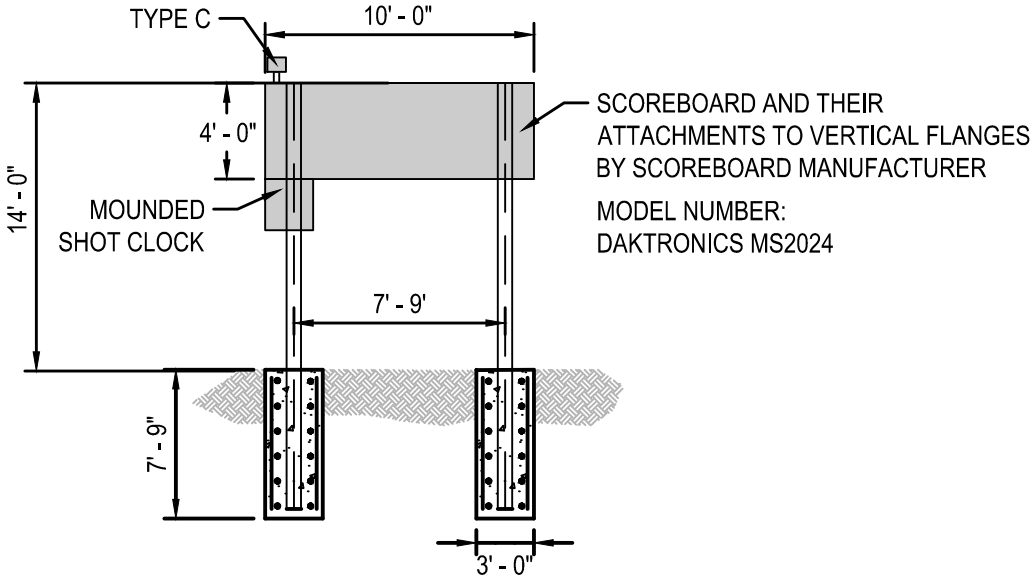

4 SOCCER SCOREBOARD DETAIL

SCALE: N.T.S.

ADDITIONAL ELECTRICAL SITE DETAILS

2025 ERWIN VALLEY ELEM & ADMIN BUILDING ALTERATIONS
CORNING-PAINTED POST AREA SCHOOL DISTRICT
16 BEARTOWN ROAD, PAINTED POST, NY 14870


Copyright: 2026

HUNT ENGINEERS | ARCHITECTS | SURVEYORS
HORSEHEADS, NY 607 - 358 - 1000 ROCHESTER, NY 585 - 327 - 7950
TOWANDA, PA 570 - 265 - 4868 BINGHAMTON, NY 607 - 798 - 8081
ALBANY, NY 607 - 798 - 8081 WWW.HUNT-EAS.COM
NY CERTIFICATE NO. 0018220 PA CERTIFICATE NO. TSC2203131464-1

AD2-E3

DATE:

PROJECT NO:
PROJECT_NUMBER

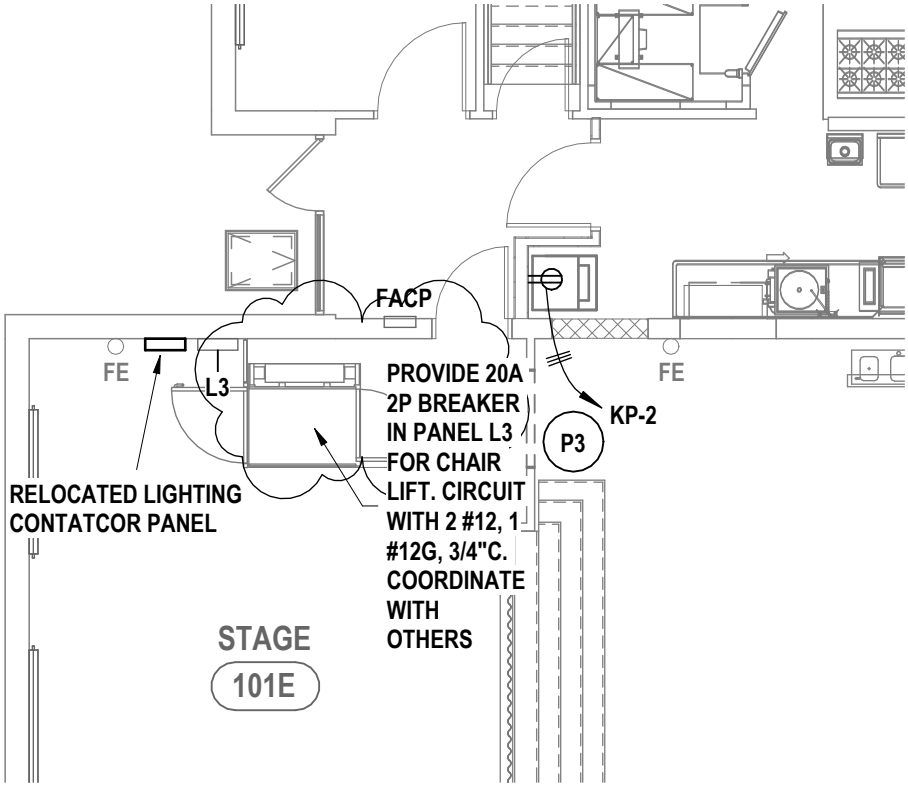

1 FIRST FLOOR POWER PLAN - STAGE POWER PLAN

1/8" = 1'-0"

PARTIAL STAGE POWER PLAN

2025 ERWIN VALLEY ELEM & ADMIN BUILDING ALTERATIONS

CORNING-PAINTED POST AREA SCHOOL DISTRICT

16 BEARTOWN ROAD, PAINTED POST, NY 14870

Copyright: 2026

HUNT ENGINEERS | ARCHITECTS | SURVEYORS
ALBANY, NY - BINGHAMTON, NY - HORSEHEADS, NY - ROCHESTER, NY
TOWANDA, PA - WILLIAMSPORT, PA
WWW.HUNT-EAS.COM 607 - 358 - 1000
NY CERTIFICATE NO. 0018220 PA CERTIFICATE NO. TSC2203131464-1

AD2-E4

DATE: 11/11/26

PROJECT NO: 2649-160

DEMOLITION NOTES - ELECTRICAL

D1 EXISTING DEVICES ON THIS ENTRY TO BE DISCONNECTED AND STORED IN A SAFE DRY PLACE FOR RE-USE.

D2 BY BASE BID, REMOVE ALL ELECTRICAL DEVICES IN SPACE. EXISTING FIRE ALARM DEVICES TO BE STORED AND RE-USED.

D3 BY ALT. #1, REMOVE ALL ELECTRICAL DEVICES IN SPACE. EXISTING FIRE ALARM DEVICES TO BE STORED AND RE-USED.


D4 DISCONNECT AND REMOVE ALL ELECTRICAL DEVICES IN THIS LOCATION. REMOVE ALL WIRE, CONDUIT, RACEWAY, BOXES, AND SUPPORTS COMPLETE BACK TO SOURCE. EXISTING DEVICES TO BE RE-USED.

D5 DISCONNCET AND REMOVE EXISTING CEILING LIGHT. SECURE EXISTING SWITCHING CIRCUITRY FOR REUSE. TURN OVER LIGHT FIXTURE TO OWNER.


D6 EXISTING CONDUIT ALONG WINDSILL TO BE RELOCATED WITH WIRE TO ABOVE NEW WALL. COORDINATE WITH OTHER TRADES FOR NEW WALL.

D7 EXISTING CONDUIT GOING THROUGH FLOOR/WLLS IN THIS LOCATION TO BE RELOCATED FOR NEW DOOR ENTRY. COORDINATE WITH OTHER TRADES FOR RELOCATION.

D8 EXISTING DEVICES IN THIS LOCATION TO BE TEMPORARILY HUNG DURING NEW WORK AND RE-INSTALLED INTO NEW GRID AFTER WORK IS COMPLETED. COORDINATE WITH OTHERS.

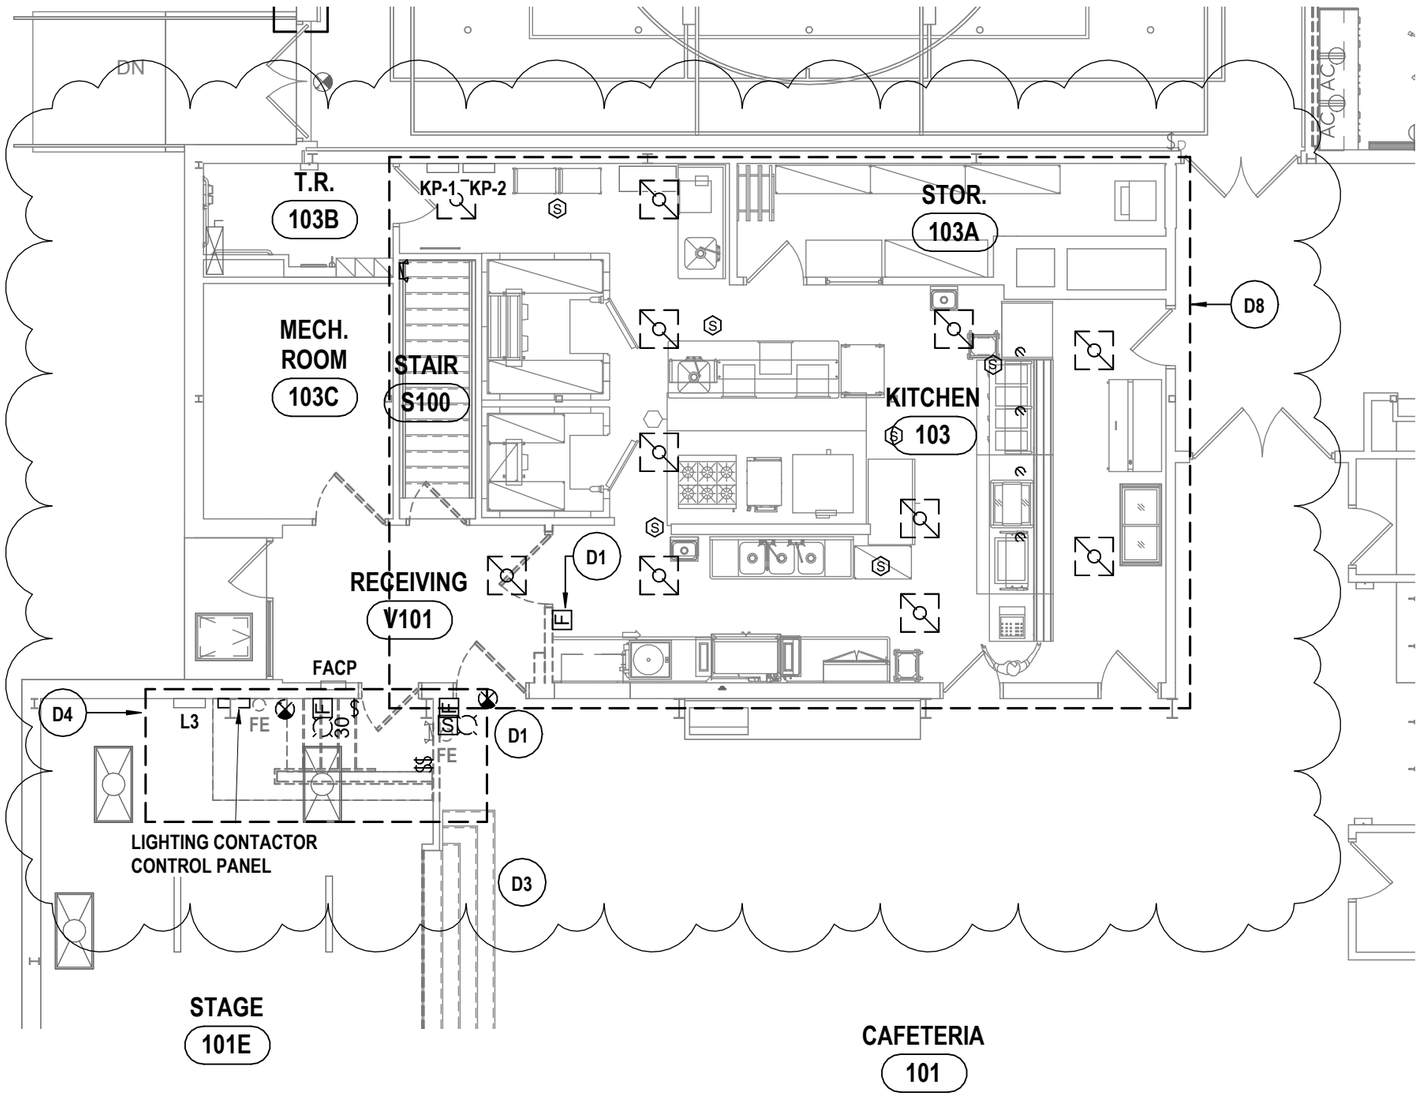

1 FIRST FLOOR ELECTRICAL DEMOLITION PLAN - KITCHEN
1/8" = 1'-0"

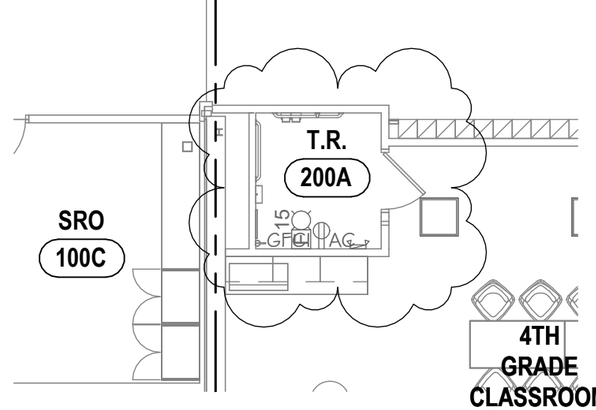

2 FIRST FLOOR ELECTRICAL DEMOLITION PLAN - RR 200A
1/8" = 1'-0"

DRAWN BY:	SPS
CHECKED BY:	TAWC
DATE:	11/11/26

Copyright: 2026


"IT IS A VIOLATION OF THE LAW FOR ANY PERSON TO MAKE UNAUTHORIZED ALTERATIONS OR ADDITIONS TO PLANS BEARING A LICENSED ENGINEER'S, ARCHITECT'S OR SURVEYOR'S SEAL."

HUNT ENGINEERS | ARCHITECTS | SURVEYORS
ALBANY, NY - BINGHAMTON, NY - HORSEHEADS, NY - ROCHESTER, NY
TOWANDA, PA - WILLIAMSPORT, PA
WWW.HUNT-EAS.COM 607 - 358 - 1000
NY CERTIFICATE NO. 0018220 PA CERTIFICATE NO. TSC22031314464-1

PARTIAL FIRST FLOOR DEMOLITION PLAN
2025 ERWIN VALLEY ELEM & ADMIN BUILDING ALTERATIONS
CORNING-PAINTED POST AREA SCHOOL DISTRICT
16 BEARTOWN ROAD, PAINTED POST, NY 14870

AD2-E5

PROJECT NO: 2649-160

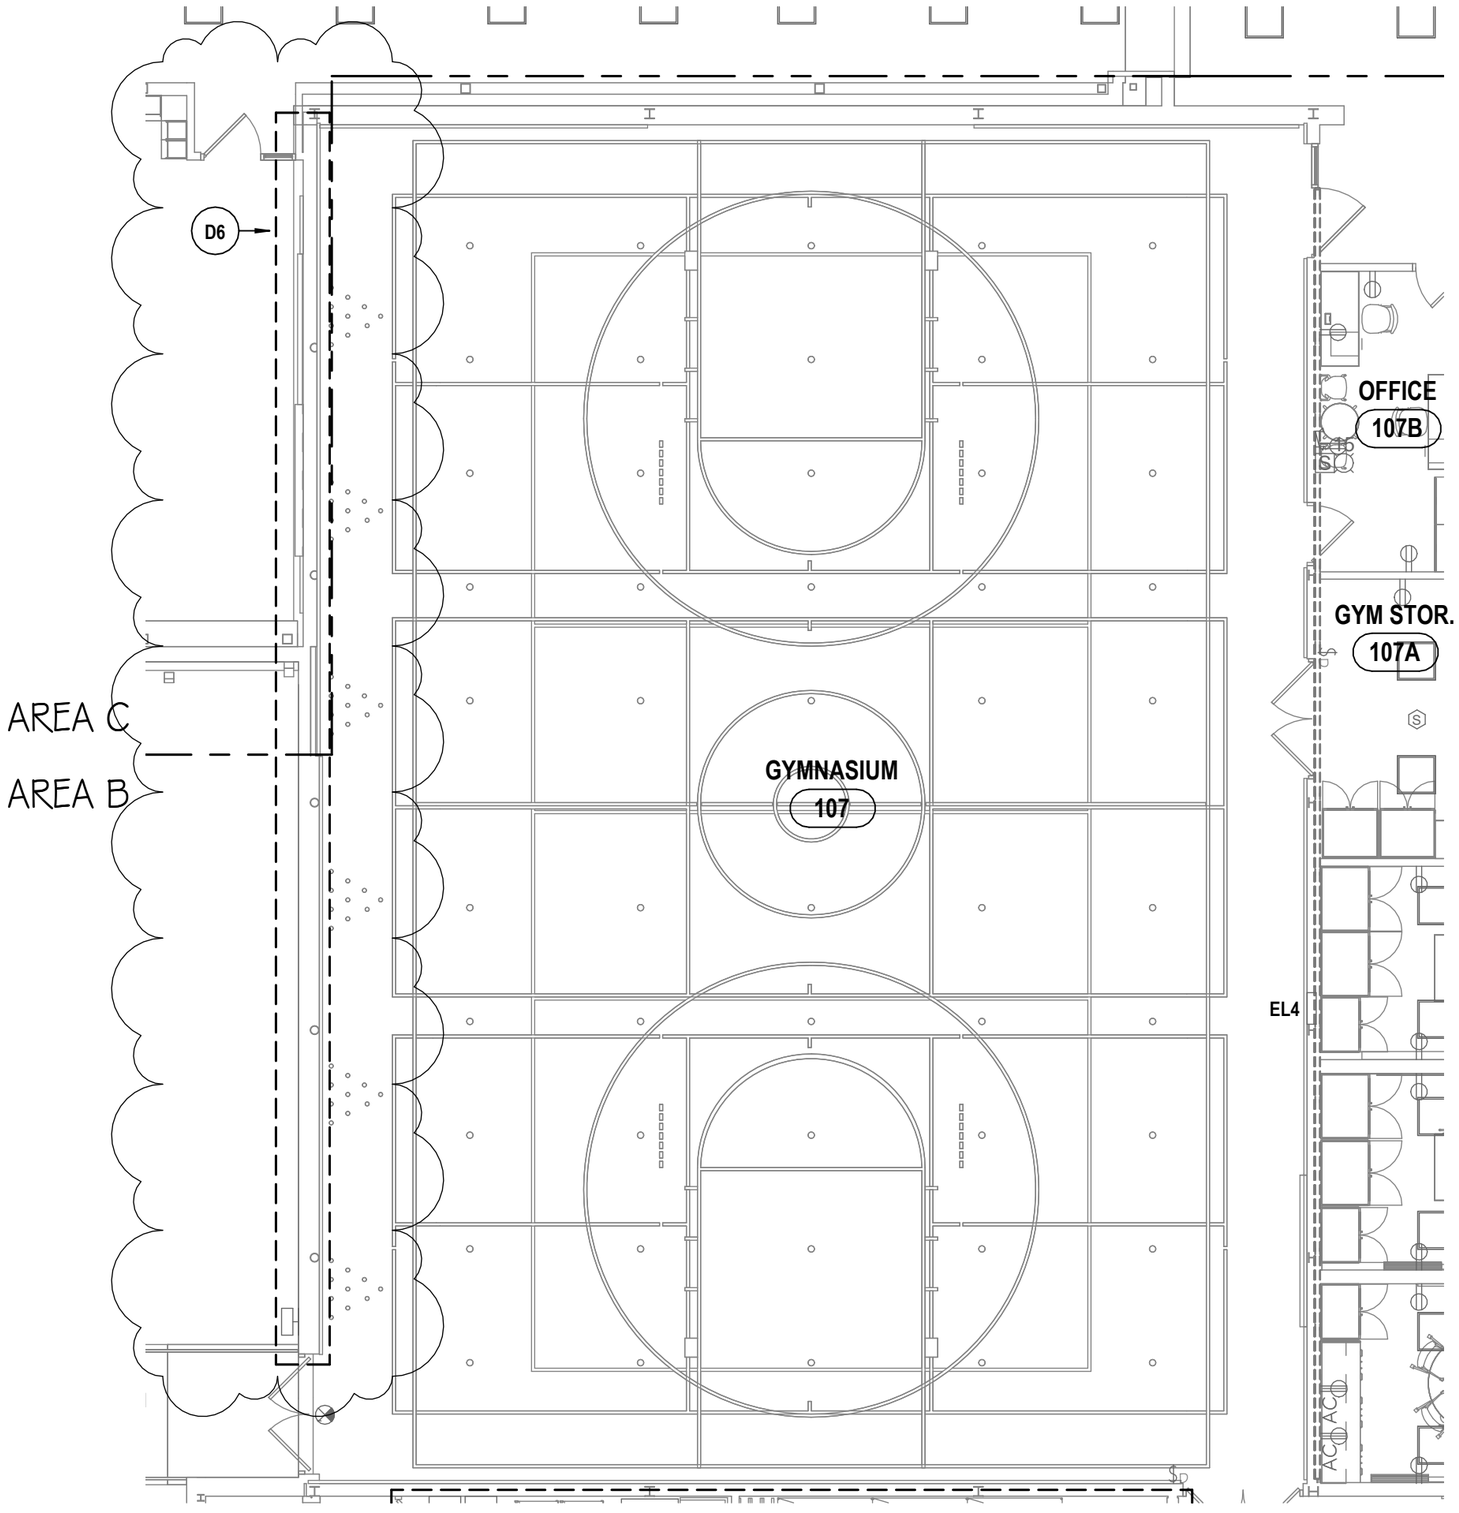

1 **FIRST FLOOR ELECTRICAL DEMOLITION PLAN - GYM**
1/8" = 1'-0"

DEMOLITION NOTES - ELECTRICAL

D1 EXISTING DEVICES ON THIS ENTRY TO BE DISCONNECTED AND STORED IN A SAFE DRY PLACE FOR RE-USE.

D2 BY BASE BID, REMOVE ALL ELECTRICAL DEVICES IN SPACE. EXISTING FIRE ALARM DEVICES TO BE STORED AND RE-USED.

D3 BY ALT. #1, REMOVE ALL ELECTRICAL DEVICES IN SPACE. EXISTING FIRE ALARM DEVICES TO BE STORED AND RE-USED.

D4 DISCONNECT AND REMOVE ALL ELECTRICAL DEVICES IN THIS LOCATION. REMOVE ALL WIRE, CONDUIT, RACEWAY, BOXES, AND SUPPORTS COMPLETE BACK TO SOURCE. EXISTING DEVICES TO BE RE-USED.

D5 DISCONNCET AND REMOVE EXISTING CEILING LIGHT. SECURE EXISTING SWITCHING CIRCUITRY FOR REUSE. TURN OVER LIGHT FIXTURE TO OWNER.

D6 EXISTING CONDUIT ALONG WINDSILL TO BE RELOCATED WITH WIRE TO ABOVE NEW WALL. COORDINATE WITH OTHER TRADES FOR NEW WALL.

D7 EXISTING CONDUIT GOING THROUGH FLOOR/WLLS IN THIS LOCATION TO BE RELOCATED FOR NEW DOOR ENTRY. COORDINATE WITH OTHER TRADES FOR RELOCATION.

D8 EXISTING DEVICES IN THIS LOCATION TO BE TEMPORARILY HUNG DURING NEW WORK AND RE-INSTALLED INTO NEW GRID AFTER WORK IS COMPLETED. COORDINATE WITH OTHERS.

DRAWN BY:	SPS
CHECKED BY:	TAWC
DATE:	11/11/26

Copyright: 2026

"IT IS A VIOLATION OF THE LAW FOR ANY PERSON TO MAKE UNAUTHORIZED ALTERATIONS OR ADDITIONS TO PLANS BEARING A LICENSED ENGINEER'S, ARCHITECT'S OR SURVEYOR'S SEAL."

HUNT ENGINEERS | ARCHITECTS | SURVEYORS
ALBANY, NY - BINGHAMTON, NY - HORSEHEADS, NY - ROCHESTER, NY
TOWANDA, PA - WILLIAMSPORT, PA
WWW.HUNT-EAS.COM 607 - 358 - 1000
NY CERTIFICATE NO. 0018220 PA CERTIFICATE NO. TSC22031314464-1

PARTIAL FIRST FLOOR DEMOLITION PLAN
2025 ERWIN VALLEY ELEM & ADMIN BUILDING ALTERATIONS
CORNING-PAINTED POST AREA SCHOOL DISTRICT
16 BEARTOWN ROAD, PAINTED POST, NY 14870

AD2-E6

PROJECT NO: 2649-160

MECHANICAL EQUIPMENT CONNECTION AND CONTROL SCHEDULE

EQUIPMENT						SUPPLY				CONTROL DEVICES MOUNTED IN ROOMS AS SCHEDULED AND AS SHOWN ON PLANS (AU = AT UNIT)												
IDENTIFICATION / TAG	DESCRIPTION	LOCATION (ROOM #)	HORSEPOWER / KILOWATTS / FLA / MCA	PHASE	VOLTAGE	PANEL OR CONTROL CENTER	CIRCUIT BREAKER	WIRE SIZE	REFERENCE NOTES	DISCONNECT SWITCH (FURNISHED & INSTALLED BY E.C.)	DISCONNECT SWITCH (FURNISHED BY H.C. & INSTALLED BY E.C.)	PRE-WIRED/FACTORY MOUNTED DISCONNECT SWITCH (BY MNFTR.)	MANUAL MOTOR STARTER (FURNISHED & INSTALLED BY E.C.)	MAGNETIC STARTER (FURNISHED & INSTALLED BY E.C.)	COMBINATION STARTER (FURNISHED & INSTALLED BY E.C.)	VARIABLE SPEED DRIVE (FURNISHED & INSTALLED BY E.C.)	VFD PACKAGE (FURNISHED & INSTALLED BY H.C. CONNECTED BY E.C.)		PACKAGED CONTROL UNIT	SINGLE POINT CONNECTION	PROVIDE 20AMP. 120V GFCI RECEPTACLE IN WEATHERPROOF ENCLOSURE AT UNIT.
FCU-1	FAN COIL UNIT	KITCHEN	1MCA	1	120	KP1	20/1	(2)-#12 , (1)-#12 G IN 3/4"C	A			X									
FCU-2	FAN COIL UNIT	KITCHEN	1MCA	1	120	KP1	20/1	(2)-#12 , (1)-#12 G IN 3/4"C	A			X									
EF-1	EXHAUST FAN	KILN 201B	1/6HP	1	120	PB1	20/1	(2)-#12 , (1)-#12 G IN 3/4"C	-			X									

NOTE: ALL DEVICES / EQUIPMENT / HARDWARE SHALL BE SUITABLE FOR USE IN THE ENVIRONMENT INDICATED, SEE SPECIFICATIONS FOR FARTHER INFORMATION.

MECHANICAL EQUIPMENT CONNECTION AND CONTROL SCHEDULE REFERENCE NOTES:

A. PROVIDE CONNECTION THROUGH UNIT TO CONDENSATE PUMP. PROVIDE 120V RECEPTACLE AT UNIT FOR POWER.

DRAWN BY: SPS
CHECKED BY: TAWC
DATE: 11/11/26

Copyright: 2026

"IT IS A VIOLATION OF THE LAW FOR ANY PERSON TO MAKE UNAUTHORIZED ALTERATIONS OR ADDITIONS TO PLANS BEARING A LICENSED ENGINEER'S, ARCHITECT'S OR SURVEYOR'S SEAL."


HUNT ENGINEERS | ARCHITECTS | SURVEYORS
ALBANY, NY - BINGHAMTON, NY - HORSEHEADS, NY - ROCHESTER, NY
TOWANDA, PA - WILLIAMSPORT, PA
WWW.HUNT-EAS.COM 607 - 358 - 1000
NY CERTIFICATE NO. 0018220 PA CERTIFICATE NO. TSC22031314464-1

MECHANICAL CONNECTION SCHEDULE

2025 ERWIN VALLEY ELEM & ADMIN BUILDING ALTERATIONS
CORNING-PAINTED POST AREA SCHOOL DISTRICT
16 BEARTOWN ROAD, PAINTED POST, NY 14870

AD2-E7

PROJECT NO: 2649-160

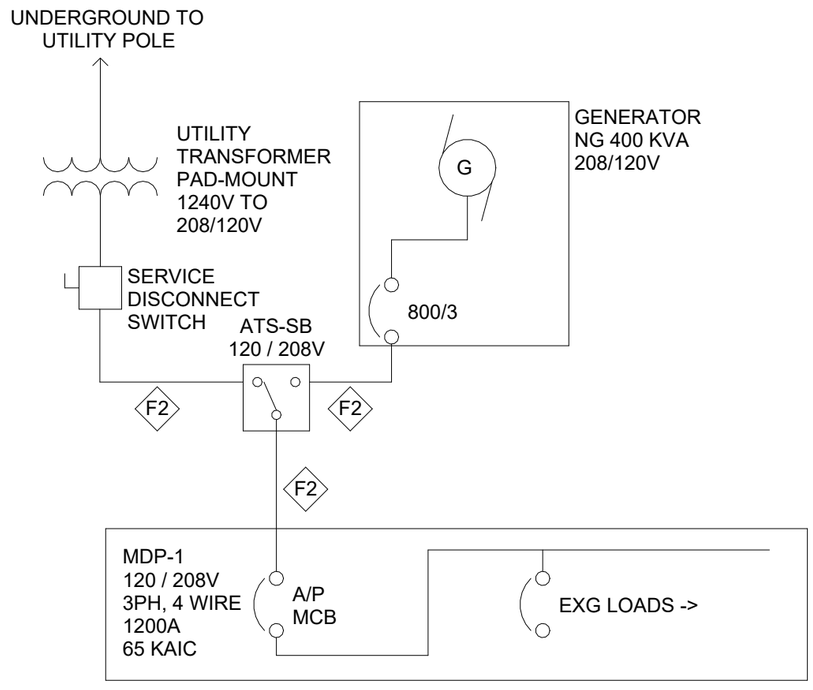

FEEDER SCHEDULE

NAME ◇	DESCRIPTION	MAX. AMPERAGE ASSUMES NO VOLTAGE DROP
F1	(4-SETS) 4- #600, 4"C.	1600 *
F2	(3-SETS) 4- #600, 4"C.	1200 *
F3	(2-SETS) 4- #600, 1-#3G, 3 1/2"C.	800
F4	(2-SETS) 4-#350, 1-#4G, 3"C	600
F5	4- #600, 4"C.	400
F6	4-#4/0, 1-#4G, 2 1/2"C	225
F7	4-#3/0, 1-#6G, 2 1/2"C	200
F8	4-#2/0, 1-#6G, 2"C	175
F9	4-#1/0, 1-#8G, 2"C	150
F10	4-#1/0, 1-#8G, 2"C	125
F11	4-#1, 1-#8G, 1 1/2"C	100
F12	4-#4, 1-#10G, 1 1/4"C	60

* SERVICE ENTRANCE FEEDER WITH NO GROUND.
REFER TO GROUND GRID DETAIL.

DRAWN BY: SPS
CHECKED BY: TAWC
DATE: 11/11/26

Copyright: 2026

"IT IS A VIOLATION OF THE LAW FOR ANY PERSON TO MAKE UNAUTHORIZED ALTERATIONS OR ADDITIONS TO PLANS BEARING A LICENSED ENGINEER'S, ARCHITECT'S OR SURVEYOR'S SEAL."


HUNT ENGINEERS | ARCHITECTS | SURVEYORS
ALBANY, NY - BINGHAMTON, NY - HORSEHEADS, NY - ROCHESTER, NY
TOWANDA, PA - WILLIAMSPORT, PA
WWW.HUNT-EAS.COM 607 - 358 - 1000
NY CERTIFICATE NO. 0018220 PA CERTIFICATE NO. TSC22031314464-1

ONE LINE REVISIONS

2025 ERWIN VALLEY ELEM & ADMIN BUILDING ALTERATIONS
CORNING-PAINTED POST AREA SCHOOL DISTRICT
16 BEARTOWN ROAD, PAINTED POST, NY 14870

AD2-E8

PROJECT NO: 2649-160

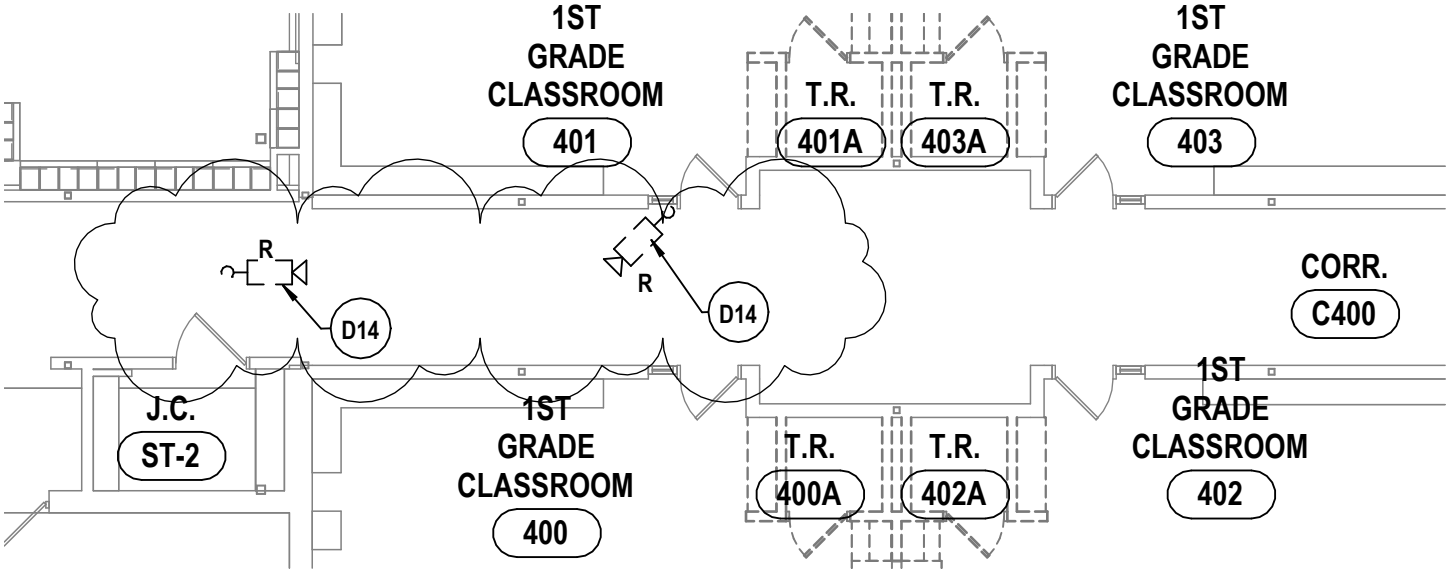

1 FIRST FLOOR TECHNOLOGY DEMO PLAN - CORRIDOR C400

1" = 10'-0"

REVISED AREA D CORRIDOR

2025 ERWIN VALLEY ELEM & ADMIN BUILDING ALTERATIONS

CORNING-PAINTED POST AREA SCHOOL DISTRICT

16 BEARTOWN ROAD, PAINTED POST, NY 14870


Copyright: 2026

HUNT ENGINEERS | ARCHITECTS | SURVEYORS
ALBANY, NY - BINGHAMTON, NY - HORSEHEADS, NY - ROCHESTER, NY
TOWANDA, PA - WILLIAMSPORT, PA
WWW.HUNT-EAS.COM 607 - 358 - 1000
NY CERTIFICATE NO. 0018220 PA CERTIFICATE NO. TSC2203131464-1

AD2-T1

DATE: 11/11/26

PROJECT NO: 2649-160

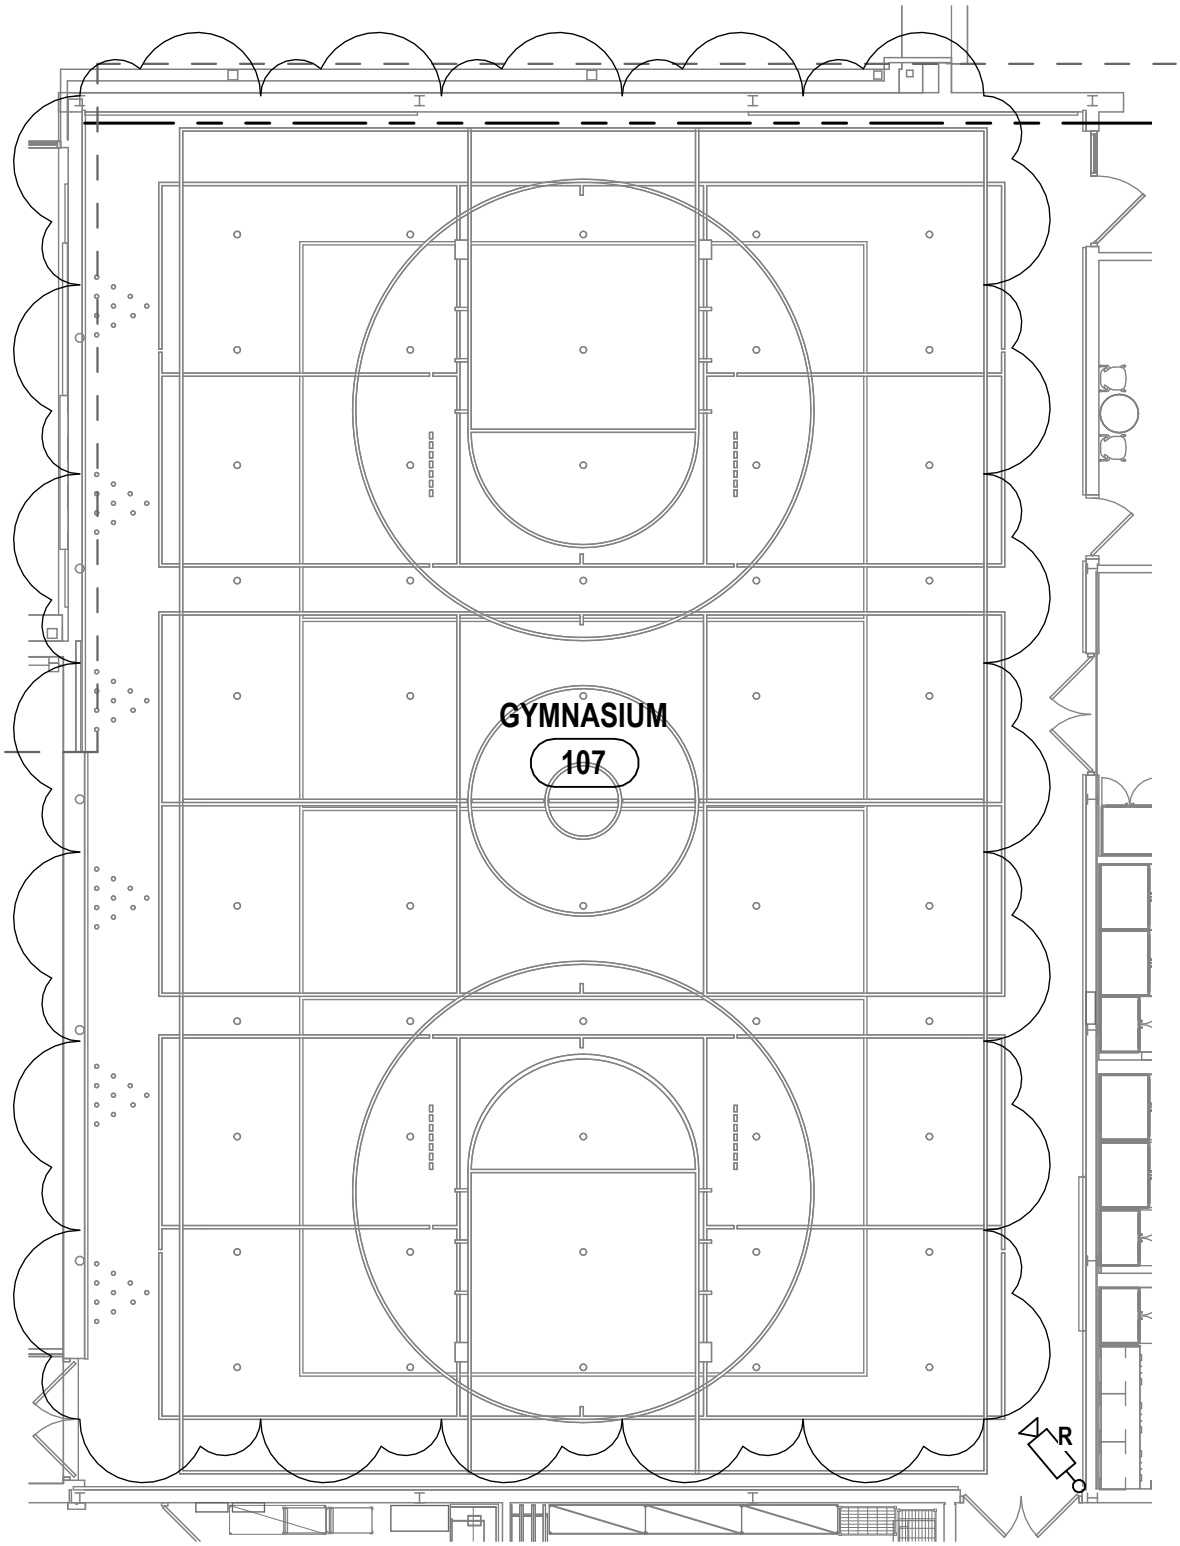

1 FIRST FLOOR TECHNOLOGY PLAN - GYM

1" = 10'-0"

GYM TECHNOLOGY PLAN

2025 ERWIN VALLEY ELEM & ADMIN BUILDING ALTERATIONS

CORNING-PAINTED POST AREA SCHOOL DISTRICT

16 BEARTOWN ROAD, PAINTED POST, NY 14870

Copyright: 2026


HUNT ENGINEERS | ARCHITECTS | SURVEYORS

ALBANY, NY - BINGHAMTON, NY - HORSEHEADS, NY - ROCHESTER, NY
TOWANDA, PA - WILLIAMSPORT, PA
WWW.HUNT-EAS.COM 607 - 358 - 1000
NY CERTIFICATE NO. 0018220 PA CERTIFICATE NO. TSC2203131464-1

AD2-T2

DATE: 11/11/26

PROJECT NO: 2649-160

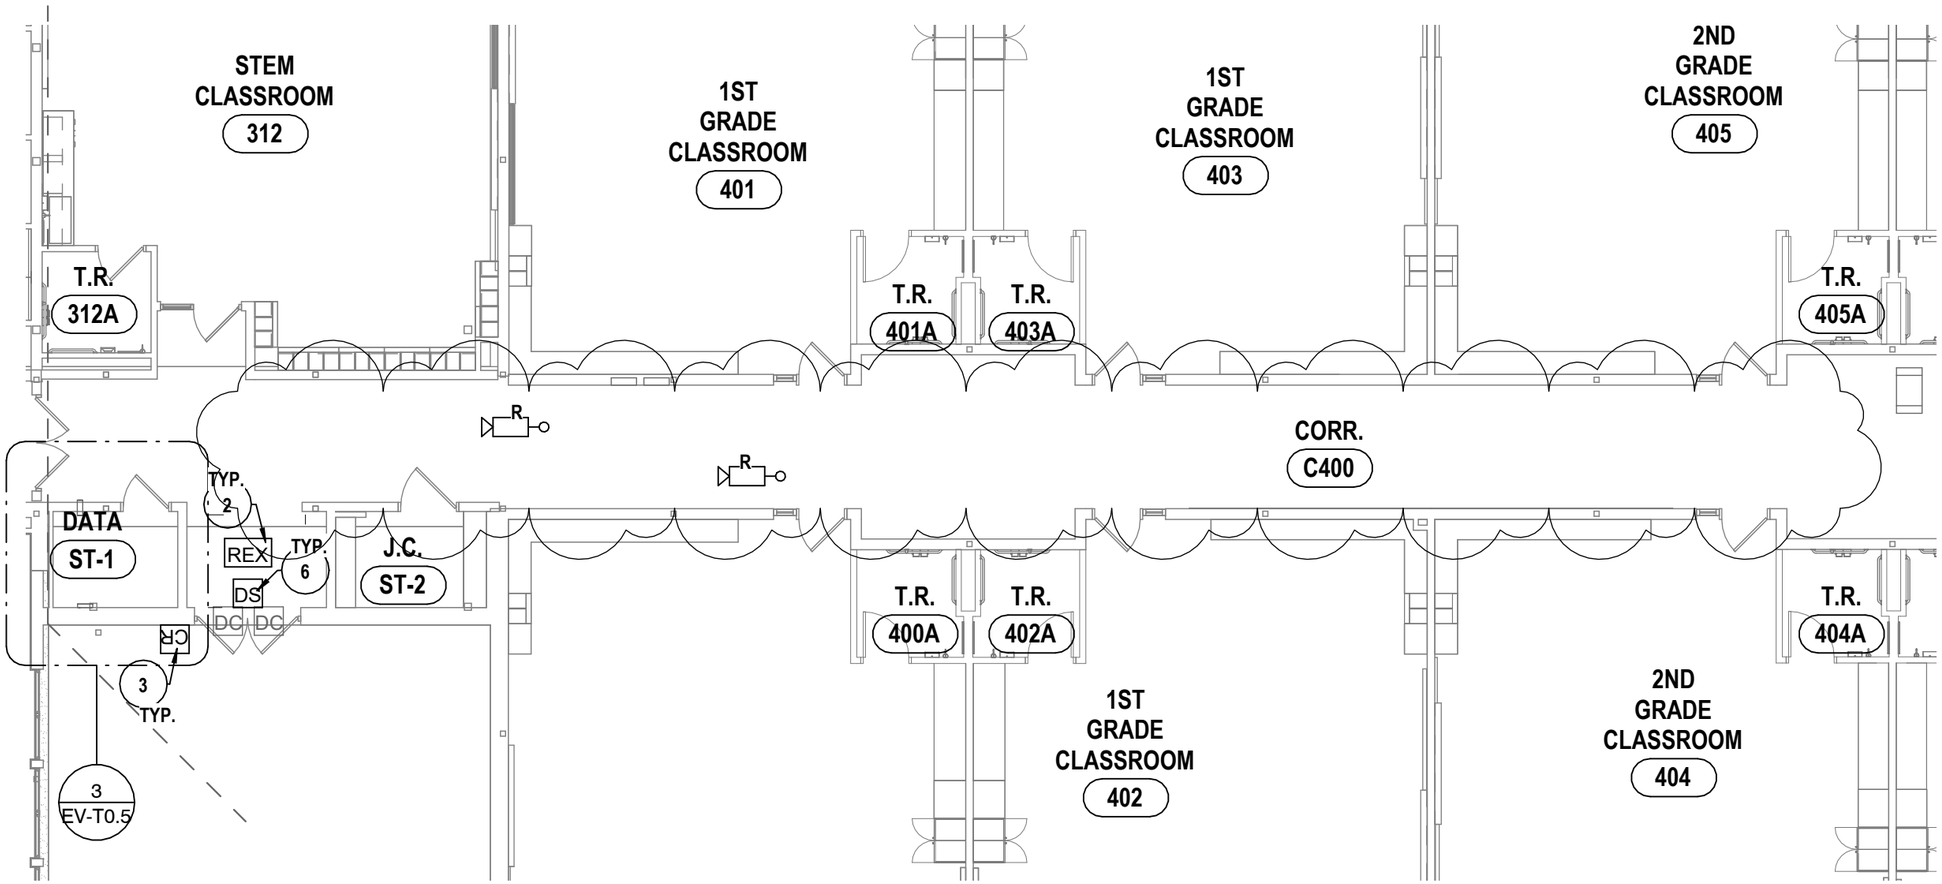

1 **FIRST FLOOR TECHNOLOGY PLAN - CORRIDOR C400 NEW WORK PLAN**
1" = 10'-0"

DRAWN BY: SPS
CHECKED BY: TAWC
DATE: 11/11/26
Copyright: 2026

"IT IS A VIOLATION OF THE LAW FOR ANY PERSON TO MAKE UNAUTHORIZED ALTERATIONS OR ADDITIONS TO PLANS BEARING A LICENSED ENGINEER'S, ARCHITECT'S OR SURVEYOR'S SEAL."

HUNT ENGINEERS | ARCHITECTS | SURVEYORS
ALBANY, NY - BINGHAMTON, NY - HORSEHEADS, NY - ROCHESTER, NY
TOWANDA, PA - WILLIAMSPORT, PA
WWW.HUNT-EAS.COM 607 - 358 - 1000
NY CERTIFICATE NO. 0018220 PA CERTIFICATE NO. TSC22031314464-1

REVISED AREA D CORRIDOR TECHNOLOGY PLAN
2025 ERWIN VALLEY ELEM & ADMIN BUILDING
ADDITION/RENOVATION
PAINTED POST AREA SCHOOL DISTRICT
16 BEARTOWN ROAD, PAINTED POST, NY 14870

AD2-T3

PROJECT NO: 2649-160